

EYEL2 - INTERIOR DESIGN

Floor Finish		Wall Finish		Ceiling Finish		Room Height	Room Noise		
Preferred	Alternate	Preferred	Alternate	Preferred	Alternate	ft - in	Min NC	Max NC	SC
VT	-	GPT	-	AT1	-	8' - 0"	30	35	40

EYEL2 - DOOR SCHEDULE

Mark	Type	Count	Height	Width	Notes
			ft - in	ft - in	
A	Single-Flush	1	7' - 0"	3' - 0"	

Room Description: Eye Lane, Electronic

NSF: 120


EYEL2

Plate Description: Room/Equipment Isometric


Scale:

Sheet
1

of
5

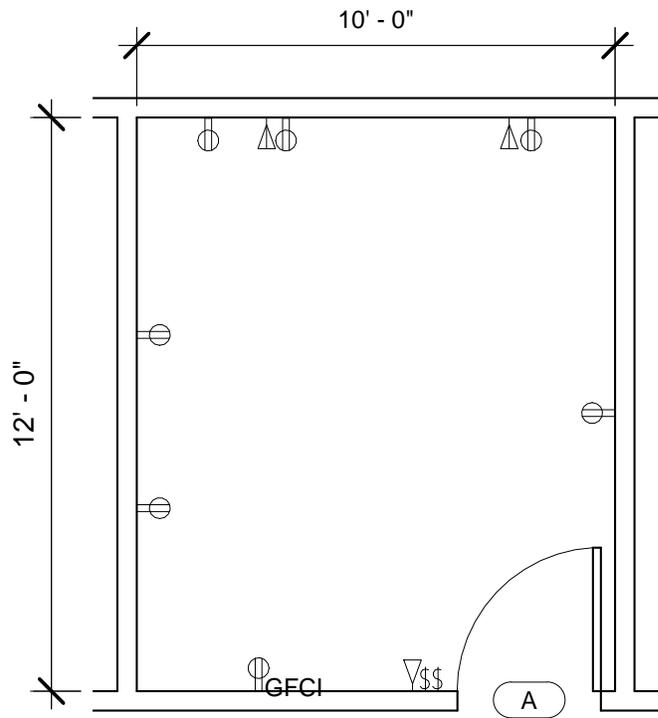


EYEL2 - FLOOR PLAN

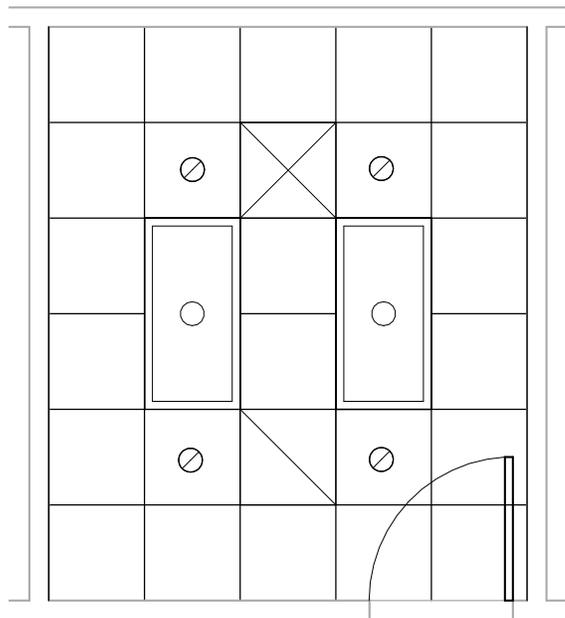

EYEL2 - CEILING PLAN


Room Description: Eye Lane, Electronic	NSF: 120	EYEL2	
Plate Description: Floor & Ceiling Plans	Scale: 1/4" = 1'-0"	Sheet 2	of 5

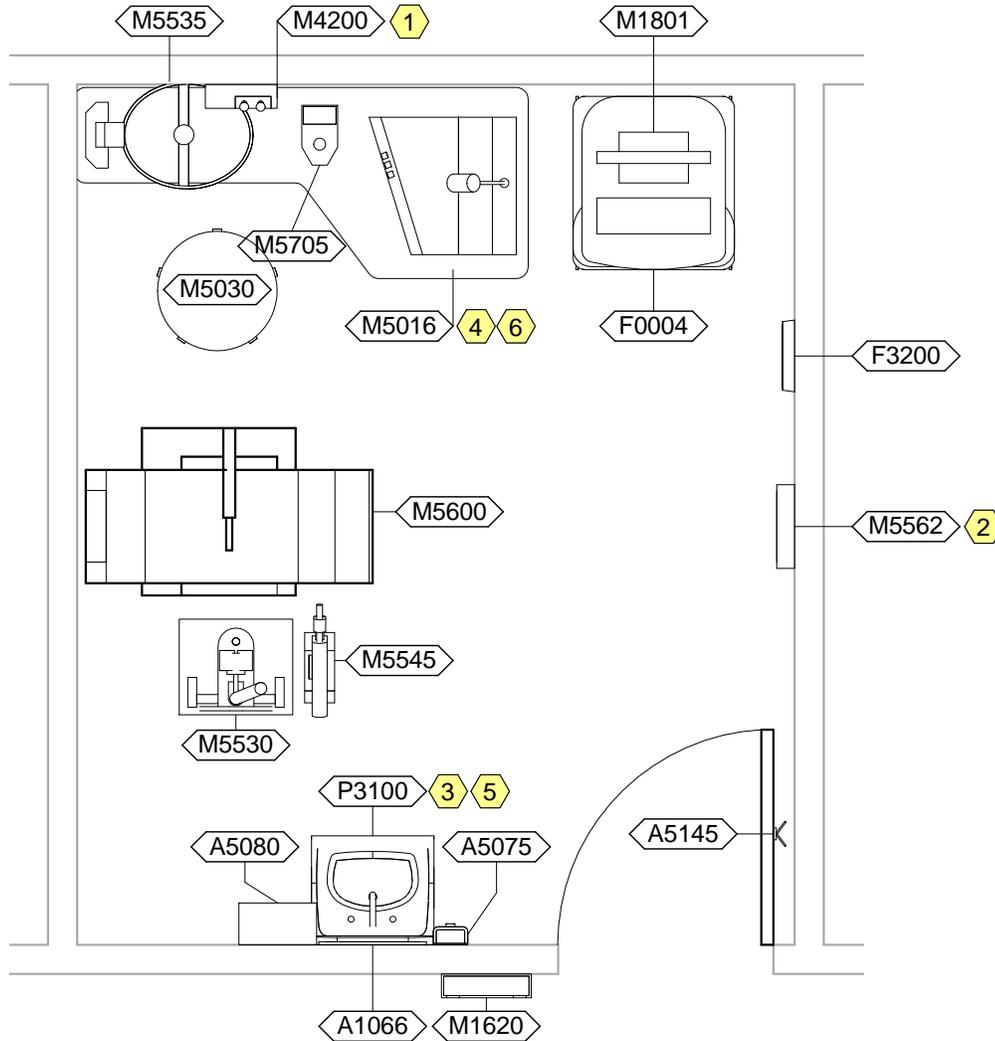


EYEL2 - NOTES

- 1 JSN M4200, Otoscope/Ophthalmoscope, is optional.
- 2 The acceptable range from JSN M5600, Chair, to JSN M5562, Visual Acuity Tester, is 6'-0" to 31'-0".
- 3 JSN P3200, Electronic Lavatory, may be used instead of JSN P3100, Lavatory. For the JSN P3200 provide either battery power or hard wired connection.
- 4 If equipment pole is mounted on the JSN M5016, Refraction Desk, instead of beside JSN M5600, Chair, JSN M5016, Refraction Desk, may need to be relocated and there will be no need for a motorized instrument stand (which might be incorporated into Chair package. This information would need to be considered if purchasing chair package). Validate instrument pole inclusion/exclusion into Refraction Desk procurement.
- 5 JSN P8710, Utility Center, shall be included in Navy projects only.
- 6 Dimming controls shall be wall mounted convenient to but not conflicting with JSN M5016, Refraction Desk.


Room Description: Eye Lane, Electronic	NSF: 120	EYEL2	
Plate Description: Equipment Plan	Scale: 3/8" = 1'-0"	Sheet 3	of 5

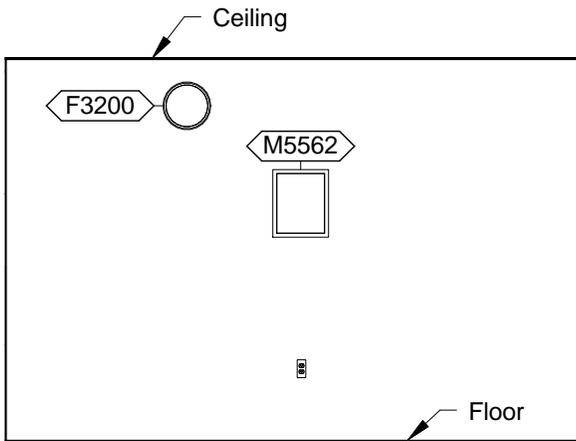


EYEL2 - PLAN EAST

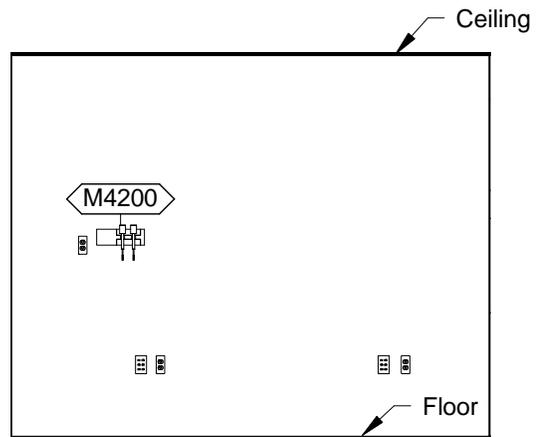

EYEL2 - PLAN NORTH

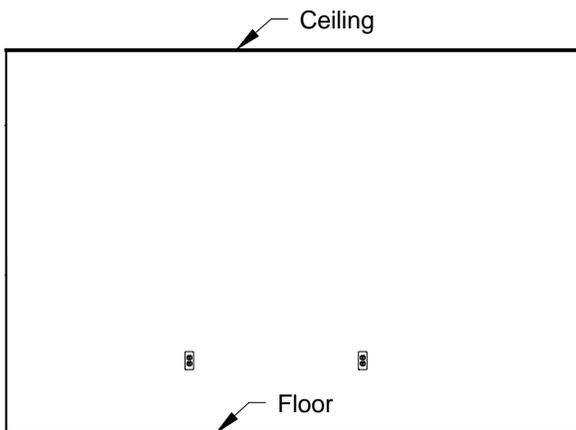

EYEL2 - PLAN WEST

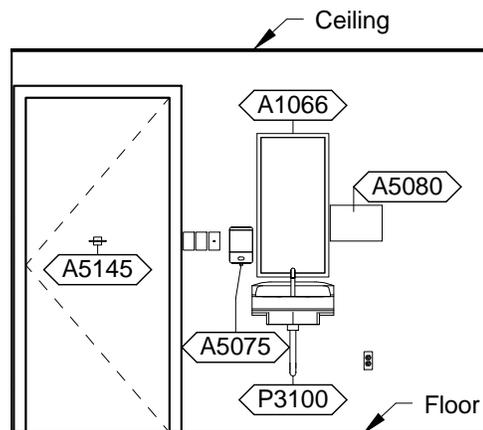

EYEL2 - PLAN SOUTH

<p>Room Description: Eye Lane, Electronic</p>	<p>NSF: 120</p>	<p>EYEL2</p>	
<p>Plate Description: Interior Room Elevations</p>	<p>Scale: 1/4" = 1'-0"</p>	<p>Sheet 4</p>	<p>of 5</p>

EYEL2 - EQUIPMENT SCHEDULE

JSN	Nomenclature	Qty	Logistics				Utilities					
			AR	NA	AF	VA	1	2	3	4	5	6
A1066	Mirror, Float Glass, With SS Frame	1	A	A	A	A	-	-	-	-	-	-
A5075	Dispenser, Soap, Disposable	1	C	C	C	C	-	-	-	-	-	-
A5080	Dispenser, Paper Towel, SS, Surface Mounted	1	A	A	A	A	-	-	-	-	-	-
A5145	Hook, Garment, Double, SS, Surface Mounted	1	A	A	A	A	-	-	-	-	-	-
F0004	Mobile, Workstation	1	C	C	C	C	-	-	-	-	-	-
F3200	Clock, Battery, 12" Diameter	1	C	C	C	C	-	-	-	-	-	-
M1620	Holder, Chart, Patient, Wall or Door Mounted	1	A	A	A	A	-	-	-	-	-	-
M1801	Computer, Microprocessing, w/Flat Panel Monitor	1	C	C	C	C	-	A	-	-	-	-
M4200	Otoscope/Ophthalmoscope, Wall Mounted	1	C	C	-	C	-	A	-	-	-	-
M5016	Desk, Refraction w/console, w/o Sink	1	A	E	A	A	-	F	-	-	-	-
M5030	Stool, Surgeon, Revolving	1	C	C	C	C	-	-	-	-	-	-
M5530	Lamp, Slit, w/Applanation Tonometer	1	C	C	C	C	-	A	-	-	-	-
M5535	Ophthalmoscope, Binocular, Indirect	1	C	C	C	C	-	A	-	-	-	-
M5545	Ophthalmometer/Keratometer	1	C	C	C	C	-	A	-	-	-	-
M5562	Tester, Visual Acuity, Video/Microprocessor Based	1	C	C	C	C	-	A	-	-	-	-
M5600	Unit, Exam, Eye, w/Motor Chair, Phoropter	1	C	C	C	C	-	A	-	-	-	-
M5705	Gauge, Distance, Pupillary	1	C	C	C	C	-	-	-	-	-	-
P3100	Lavatory, Vitreous China, Slab Type	1	A	A	A	A	D	-	-	-	-	-

EYEL2 - DATA/TELEPHONE EQUIPMENT

JSN	Nomenclature	Qty	Logistics			
			AR	NA	AF	VA
A1010	Telecommunication Outlet	2	A	A	A	A
A1014	Telephone, Wall Mounted, 1 Line, with Speaker	1	A	A	A	A

Room Description: Eye Lane, Electronic	NSF: 120	EYEL2	
Plate Description: Equipment Schedule	Scale:	Sheet 5	of 5