

**NOTES**


1. A PEDIATRIC E0954, EMERGENCY CART, A PEDIATRIC M7660, DEFIBRILLATOR, AND AN INFANT TRANSPORTER, EITHER M0805 OR M0810, SHALL BE IN THE VICINITY OF THE NORMAL NURSERY. THE SPECIFIC EQUIPMENT WILL BE SELECTED AT THE DISCRETION OF THE STAFF AND THE FUNCTION OF THE NURSERY.
2. COORDINATE REQUIREMENTS FOR INFANT THEFT SECURITY SYSTEM WITH USING MILITARY DEPARTMENT.

**KEY NOTES**

1. MOUNT A5145, HOOK, AT 1372 [4'-6"] AFF. PROVIDE 2-A5145'S FOR NAVY PROJECTS ONLY. MOUNT 1-A5145 AT 1372 [4'-6"] AFF AND 1-A5145 AT 1524 [5'-0"] AFF.
2. ROOM DIMENSIONS MAY VARY.
3. WINDOWS WITH INTEGRAL BLINDS. WIDTH MAY VARY.
4. NUMBER OF UNITS WILL VARY ACCORDING TO THE PATIENT POPULATION SERVED. PROVIDE (1) MG-001 FOR EACH M0800.
5. P3200, UTR ELECTRONIC LAVATORY, MAY BE USED INSTEAD OF P3100, LAVATORY. FOR THE P3200 PROVIDE EITHER BATTERY POWER OR HARD WIRED CONNECTION.

NURSERY, NORMAL NEWBORN, LEVEL 1 (NYNN1)

NURSERY		0	1000	2000
FLOOR/EQUIPMENT PLAN	23.79 NSM (256 NSF)			
DATE:	07/12/2001	1:50 SCALE (MILLIMETERS)		

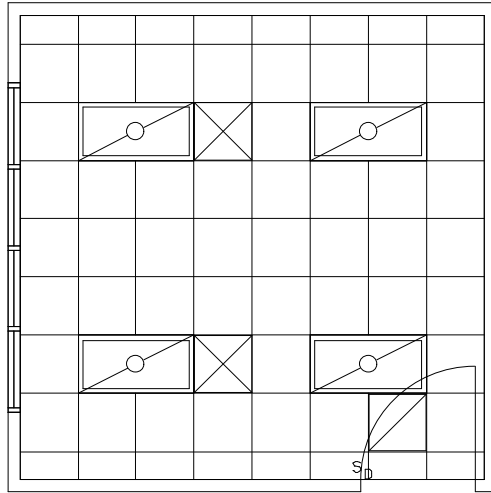

NOTES

1. SEE TYPICAL EQUIPMENT MOUNTING HEIGHTS BEGINNING ON SHEET 7.01.01.
2. P3200, UTR ELECTRONIC LAVATORY, MAY BE USED INSTEAD OF P3100, LAVATORY. FOR THE P3200 PROVIDE EITHER BATTERY POWER OR HARD WIRED CONNECTION.

NURSERY, NORMAL NEWBORN, LEVEL 1 (NYNN1)

NURSERY

0 1000 2000


CEILING PLAN

23.79 NSM (256 NSF)




DATE: 07/12/2001


1:50 SCALE (MILLIMETERS)

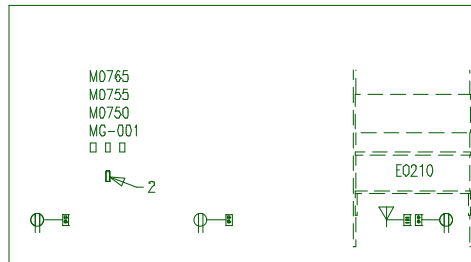

NORTH

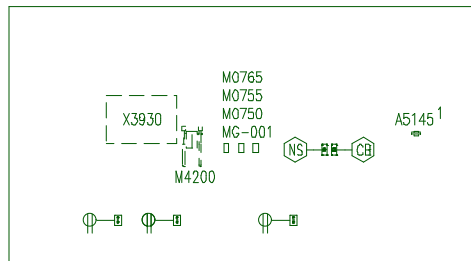

EAST

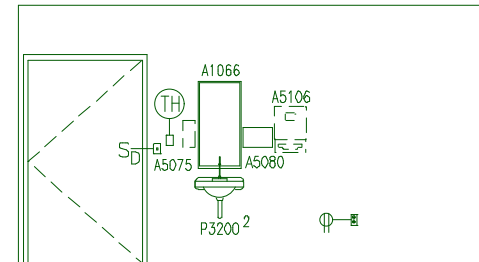

SOUTH

KEY NOTES

1. MOUNT A5145, HOOK, AT 1372 [4'-6"] AFF. PROVIDE 2-A5145'S FOR NAVY PROJECTS ONLY.  
MOUNT 1-A5145 AT 1372 [4'-6"] AFF AND 1-A5145 AT 1524 [5'-0"] AFF.
2. VACUUM SLIDE.

General Notes:

1. For typical equipment mounting heights see "TYPICAL EQUIPMENT MOUNTING HEIGHTS" drawing.
2. MIL-STD-1691 data can only be accessed from the Equipment Plan.

NOTES

1. P3200, UTR ELECTRONIC LAVATORY, MAY BE USED INSTEAD OF P3100, LAVATORY. FOR THE P3200 PROVIDE EITHER BATTERY POWER OR HARD WIRED CONNECTION.

NURSERY, NORMAL NEWBORN, LEVEL I (NYNN1)

NURSERY		0	1000	2000
ELEVATIONS	23.79 NSM (256 NSF)			

DATE: 07/12/2001

1:50 SCALE (MILLIMETERS)

Project Rooms (User Contents Only)

As of 08/12/2005

Page 1

Room Code: NYNN1 Room Qty: 1 Room Area: 256.01 Room Description: NURSERY, NORMAL NEWBORN, LEVEL 1

JSN	NOMENCLATURE	Qty	UNIT	LOG	Ut1	Ut1	Ut1	Ut1	Ut1	Ut1
			ISSUE	CAT	1	2	3	4	5	6

Equipment per Room:

A1066	Mirror, Float Glass, With SS Frame, 36X18	1	EA	A	.	.	.	.	.	.
A5075	Dispenser, Soap, Disposable	1	EA	C	.	.	.	.	.	.
A5080	Dispenser, Paper Towel, SS, Surface Mounted	1	EA	A	.	.	.	.	.	.
A5106	Waste Disposal Unit, Sharps w/Glove Dispenser	2	EA	C	.	.	.	.	.	.
A5145	Hook, Garment, Double, SS, Surface Mounted	1	EA	A	.	.	.	.	.	.
E0210	Worksurface, w/Overhead Cab, Wall Mtd, 48" W	1	EA	C	.	A	.	.	.	.
E0963	Cart, General Storage, Mobile	2	EA	C	.	.	.	.	.	.
F0270	Chair, Rocking, High Back	1	EA	C	.	.	.	.	.	.
F0280	Chair, Swivel, Low Back	1	EA	C	.	.	.	.	.	.
F2000	Basket, Wastepaper, Round, Metal, 18 H x 16 Dia.	2	EA	C	.	.	.	.	.	.
F3200	Clock, Battery, 12" Diameter	1	EA	C	.	.	.	.	.	.
M0031	Screening Device, Newborn Hearing	1	ea	C	.	A	.	.	.	.
M0750	Flowmeter, Air, Connect w/50 PSI Supply	2	EA	C	.	.	K	.	.	.
M0755	Flowmeter, Oxygen, Low Flow	2	EA	C	.	.	A	.	.	.
M0765	Regulator, Vacuum	2	EA	C	.	.	B	.	.	.
M0800	Center, Infant Care	1	EA	C	.	A	E	.	.	.
M1800	Computer, Microprocessing, w/CRT Monitor	1	EA	C	.	A	.	.	.	.
M3005	Bassinet, w/Cart	4	EA	C	.	.	.	.	.	.
M3070	Hamper, Linen, Mobile, w/Lid	1	EA	C	.	.	.	.	.	.
M3072	Frame, Infectious Waste Bag w/Lid	1	EA	C	.	.	.	.	.	.
M4200	Otoscope/Ophthalmoscope, Wall Mounted	1	EA	C	.	A	.	.	.	.
M4255	Stand, IV, Adjustable	1	EA	C	.	.	.	.	.	.
M8215	Light, Phototherapy, Mobile	1	EA	C	.	A	.	.	.	.
P3200	Lavatory, Vitreous China, Slab Type w/Sens Op Fa	1	EA	A	D	.	.	.	.	.
X3930	Illuminator, Film, Double, Wall Mounted, 20x29x6	1	EA	C	.	A	.	.	.	.

=====

\*\*\*GRAND TOTAL\*\*\*

34