
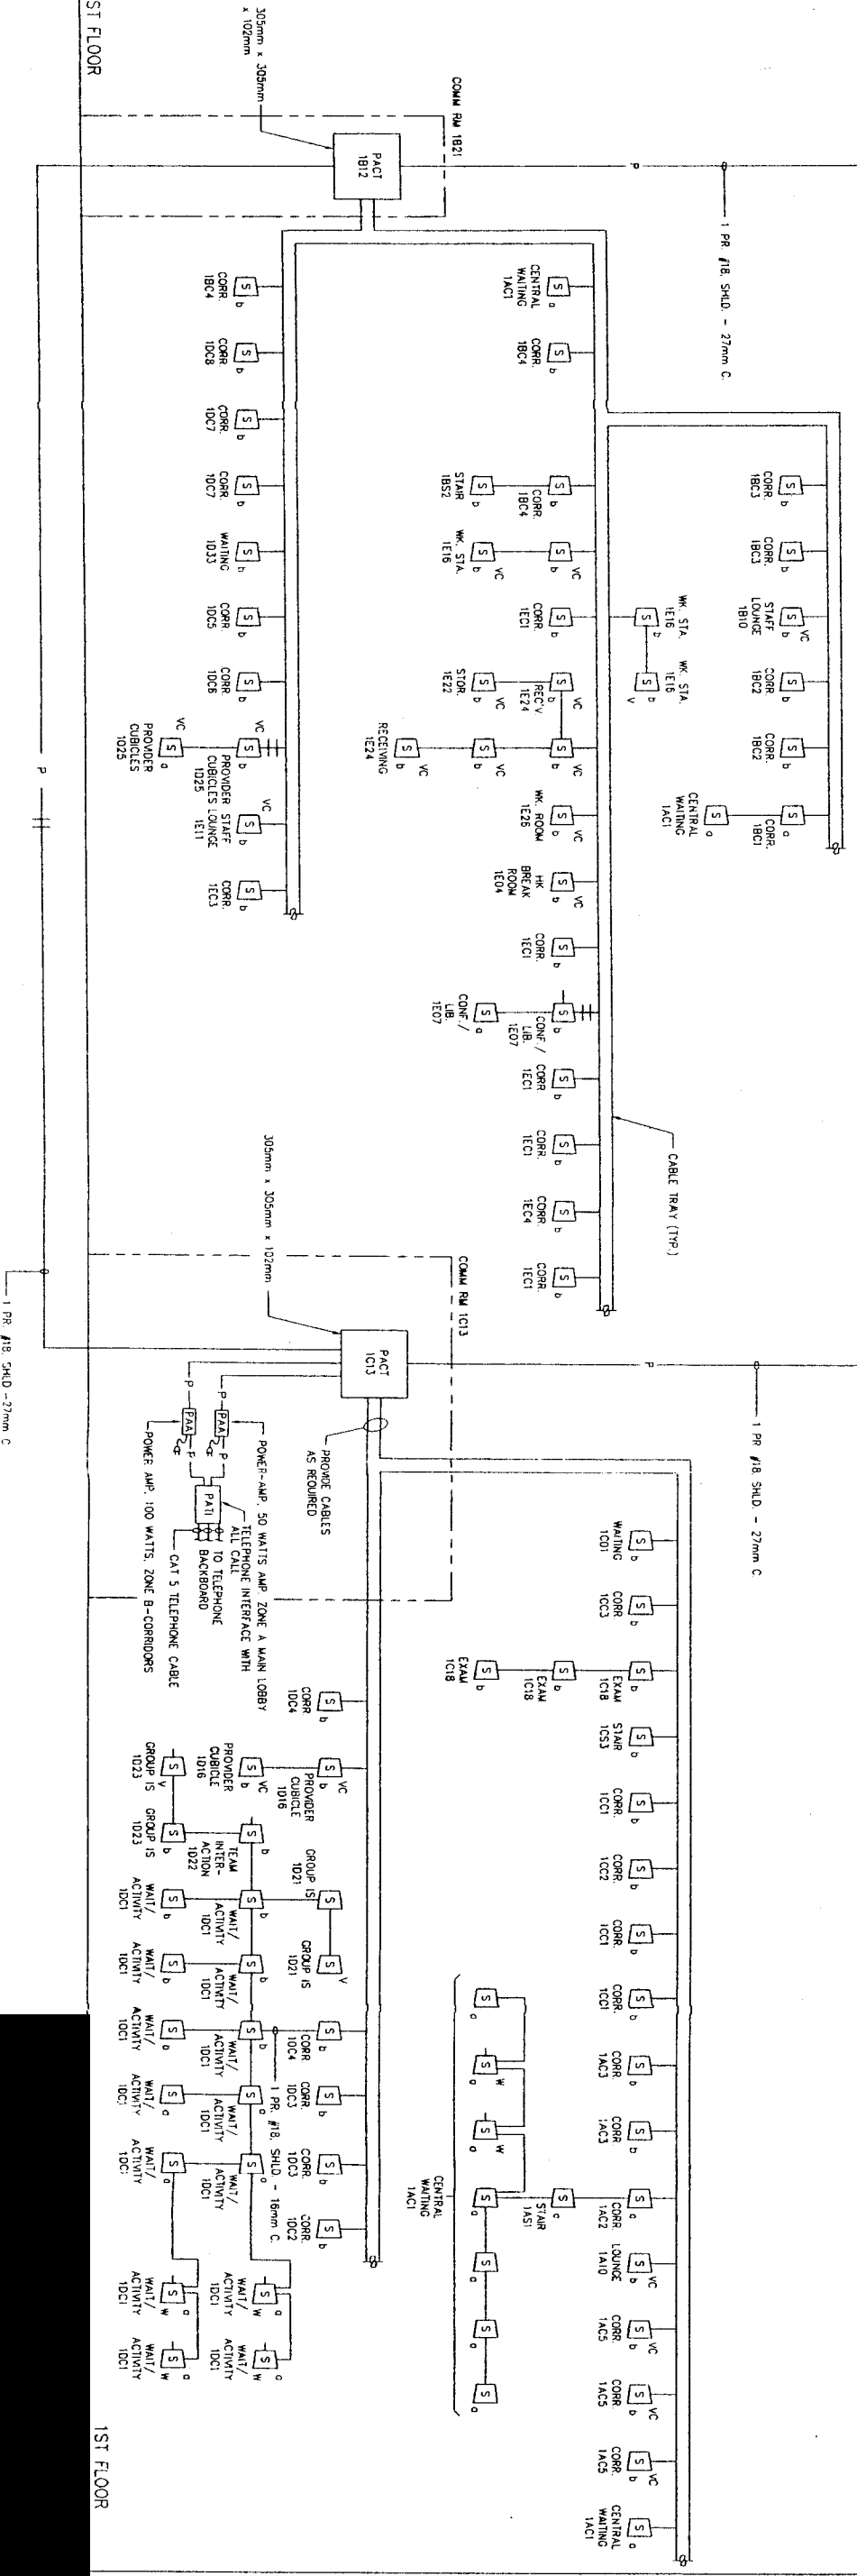


- PUBLIC ADDRESS SYSTEM:
1. ALL SPEAKER LEVEL CABLE SHALL BE INSTALLED IN CONDUIT OR CABLE TRAY.
 2. ALL MICROPHONE AND LINE LEVEL CIRCUITS SHALL BE INSTALLED IN CONDUITS ONLY.
 3. MOUNTING HEIGHTS OF PUBLIC ADDRESS SYSTEM DEVICES ABOVE FINISHED FLOOR SHALL BE AS FOLLOWS (MOUNTING HEIGHTS ARE TO CENTERLINE OF DEVICE, EXCEPT WHERE NOTED).
 4. ALL TERMINAL CABINETS SHALL BE STEEL, NEHA 1, STEEL HINGED DOOR, WITH FIRE PROOF PAINTED WOOD BACKBOARD AND BARRIER TYPE TERMINAL STRIPS.
- VOLUME CONTROL:
- | | |
|---------------------|--------|
| TELEPHONE INTERFACE | 1200mm |
| TERMINAL CABINET | 1525mm |
| WALL SPEAKER | 2400mm |

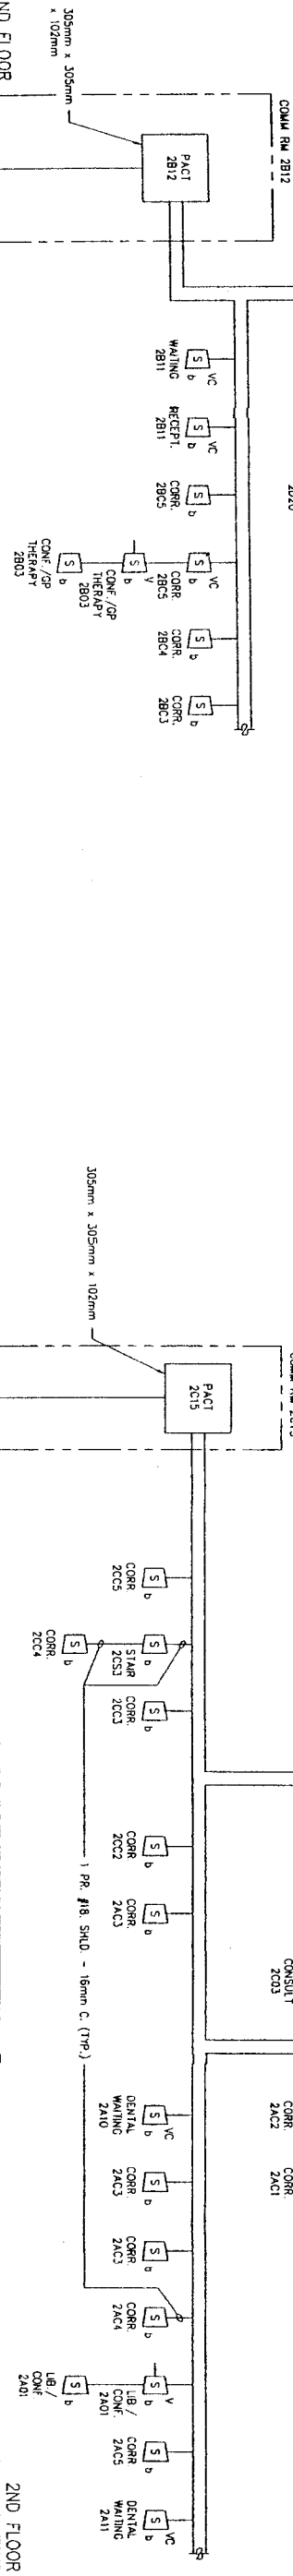

PAGING SYSTEM