

BALANCE VALVE/FLOW METER TEST REPORT


PROJECT Medical/Dental SYSTEM/UNIT AH-2
LOCATION _____

SERVICE OR DESIGNATION	SIZE	MODEL	DESIGN GPM (l/s) M 3/hr.	Design EAT/LAT	Actual EAT/LAT	ACTUAL GPM (l/s)	NOTES
V-A	1/2	*	.11	12.8/26.7	14/27	.12	
B	"	*	.16	12.8/26.7	14/27	.16	
C	"	*	.09	12.8/26.7	14/27	.09	
D	"	*	.09	12.8/26.7	14/27	.09	
E	"	*	.07	12.8/26.7	14/27	.08	
F	"	*	.09	12.8/26.7	14/27	.09	
G	"	*	.39	12.8/26.7	14/27	.40	
H	"	*	.09	12.8/26.7	14/27	.09	
I	"	*	.09	12.8/26.7	14/27	.09	
J	"	*	.32	12.8/26.7	14/27	.31	
K	"	*	.09	12.8/26.7	14/27	.09	
L	"	*	.18	12.8/31.6	14/32	.17	
M	"	*	.09	12.8/26.7	14/27	.09	
N	"	*	.34	12.8/26.7	14/27	.33	
O	"	*	.09	12.8/26.7	14/27	.09	
P	"	*	.11	12.8/26.7	14/27	.11	
Q	"	*	.09	12.8/26.7	14/27	.09	
R	"	*	.11	12.8/26.7	14/27	.11	
S	"	*	.09	12.8/26.7	14/27	.09	
T	"	*	.27	12.8/26.7	14/27	.26	
U	"	*	.09	12.8/26.7	14/27	.09	
V	"	*	.11	12.8/26.7	14/27	.10	
W	"	*	.27	12.8/26.7	14/27	.26	

REMARKS:



TEST DATE 6/3/02 READINGS BY [Redacted]




BALANCE VALVE/FLOW METER TEST REPORT


PROJECT Medical/Dental SYSTEM/UNIT AH-2
LOCATION _____

SERVICE OR DESIGNATION	SIZE	MODEL	DESIGN GPM (l/s) M 3/Hr.	Design EAT/LAT	Actual EAT/LAT	ACTUAL GPM (l/s)	NOTES
V-X	1/2	*	.34	12.8/26.7	14/27	.35	
Y	"	*	.20	12.8/26.7	14/27	.20	
Z	"	*	.30	12.8/26.7	14/27	.31	
AA	3/4	*	.73	12.8/26.7	14/27	.74	
BB	1/2	*	.14	12.8/26.7	14/27	.15	
CC	0	0	0	0	0	0	
DD	1/2	*	.07	12.8/26.7	14/27	.07	
EE	"	*	.11	12.8/26.7	14/27	.12	
GG	"	*	.18	12.8/26.7	14/27	.19	
HH			Deleted				
II	"	*	.11	12.8/26.7	14/27	.12	
JJ	"	*	.23	12.8/26.7	14/27	.23	
KK	0	0	0	0	0	0	
LL	"	*	.11	12.8/26.7	14/27	.12	
MM	"	*	.11	12.8/26.7	14/27	.11	
NN			Deleted				
OO	"	*	.11	12.8/26.7	14/27	.10	
PP	"	*	.09	12.8/26.7	14/27	.09	
QQ	"	*	.07	12.8/26.7	14/27	.07	
RR	"	*	.16	12.8/26.7	14/27	.15	
SS	"	*	.07	12.8/26.7	14/27	.07	
TT	"	*	.11	12.8/26.7	14/27	.10	
FF	"	*	.11	12.8/26.7	14/27	.11	

REMARKS:

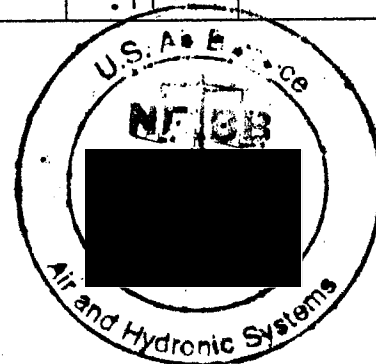

TEST DATE 6/3/02 READINGS BY [Redacted]




BALANCE VALVE/FLOW METER TEST REPORT

PROJECT Medical/Dental SYSTEM/UNIT AH-2
LOCATION _____

SERVICE OR DESIGNATION	SIZE	MODEL	DESIGN GPM (/s) M 3/hr	Design EAT/LAT	Actual EAT/LAT	ACTUAL GPM (/s)	NOTES
V-UU	1/2	*	.27	2.8/26.7	14/27	.27	
VV	"	*	.18	2.8/26.7	14/27	.19	
WW	"	*	.18	2.8/26.7	14/27	.19	
WW	"	*	.09	2.8/26.7	14/27	.09	
XX	"	*	.14	2.8/26.7	14/27	.13	
YY			Deleted				
AAA	"	*	.11	2.8/26.7	14/27	.11	
BBB	"	*	.07	2.8/26.7	14/27	.07	
CCC			Deleted				
DDD	"	*	.14	2.8/26.7	14/27	.15	
EEE	"	*	.07	2.8/28.1	14/29	.07	
FFF	"	*	.09	2.8/26.7	14/27	.10	
GGG	"	*	.11	2.8/27.2	14/27	.11	
HHH	"	*	.09	2.8/26.7	14/27	.10	
III	"	*	.09	2.8/26.7	14/27	.09	
JJJ	"	*	.14	2.8/26.7	14/27	.15	
KKK			Deleted				
LLL	"	*	.11	2.8/26.7	14/27	.12	

REMARKS:

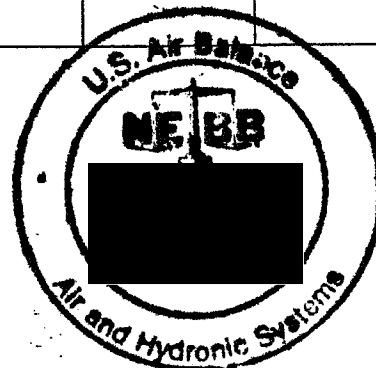

TEST DATE 6/3/02 READINGS BY [REDACTED]