


REVISIONS				
SYM	DESCRIPTION	PREPARED BY	DATE	APPROVED

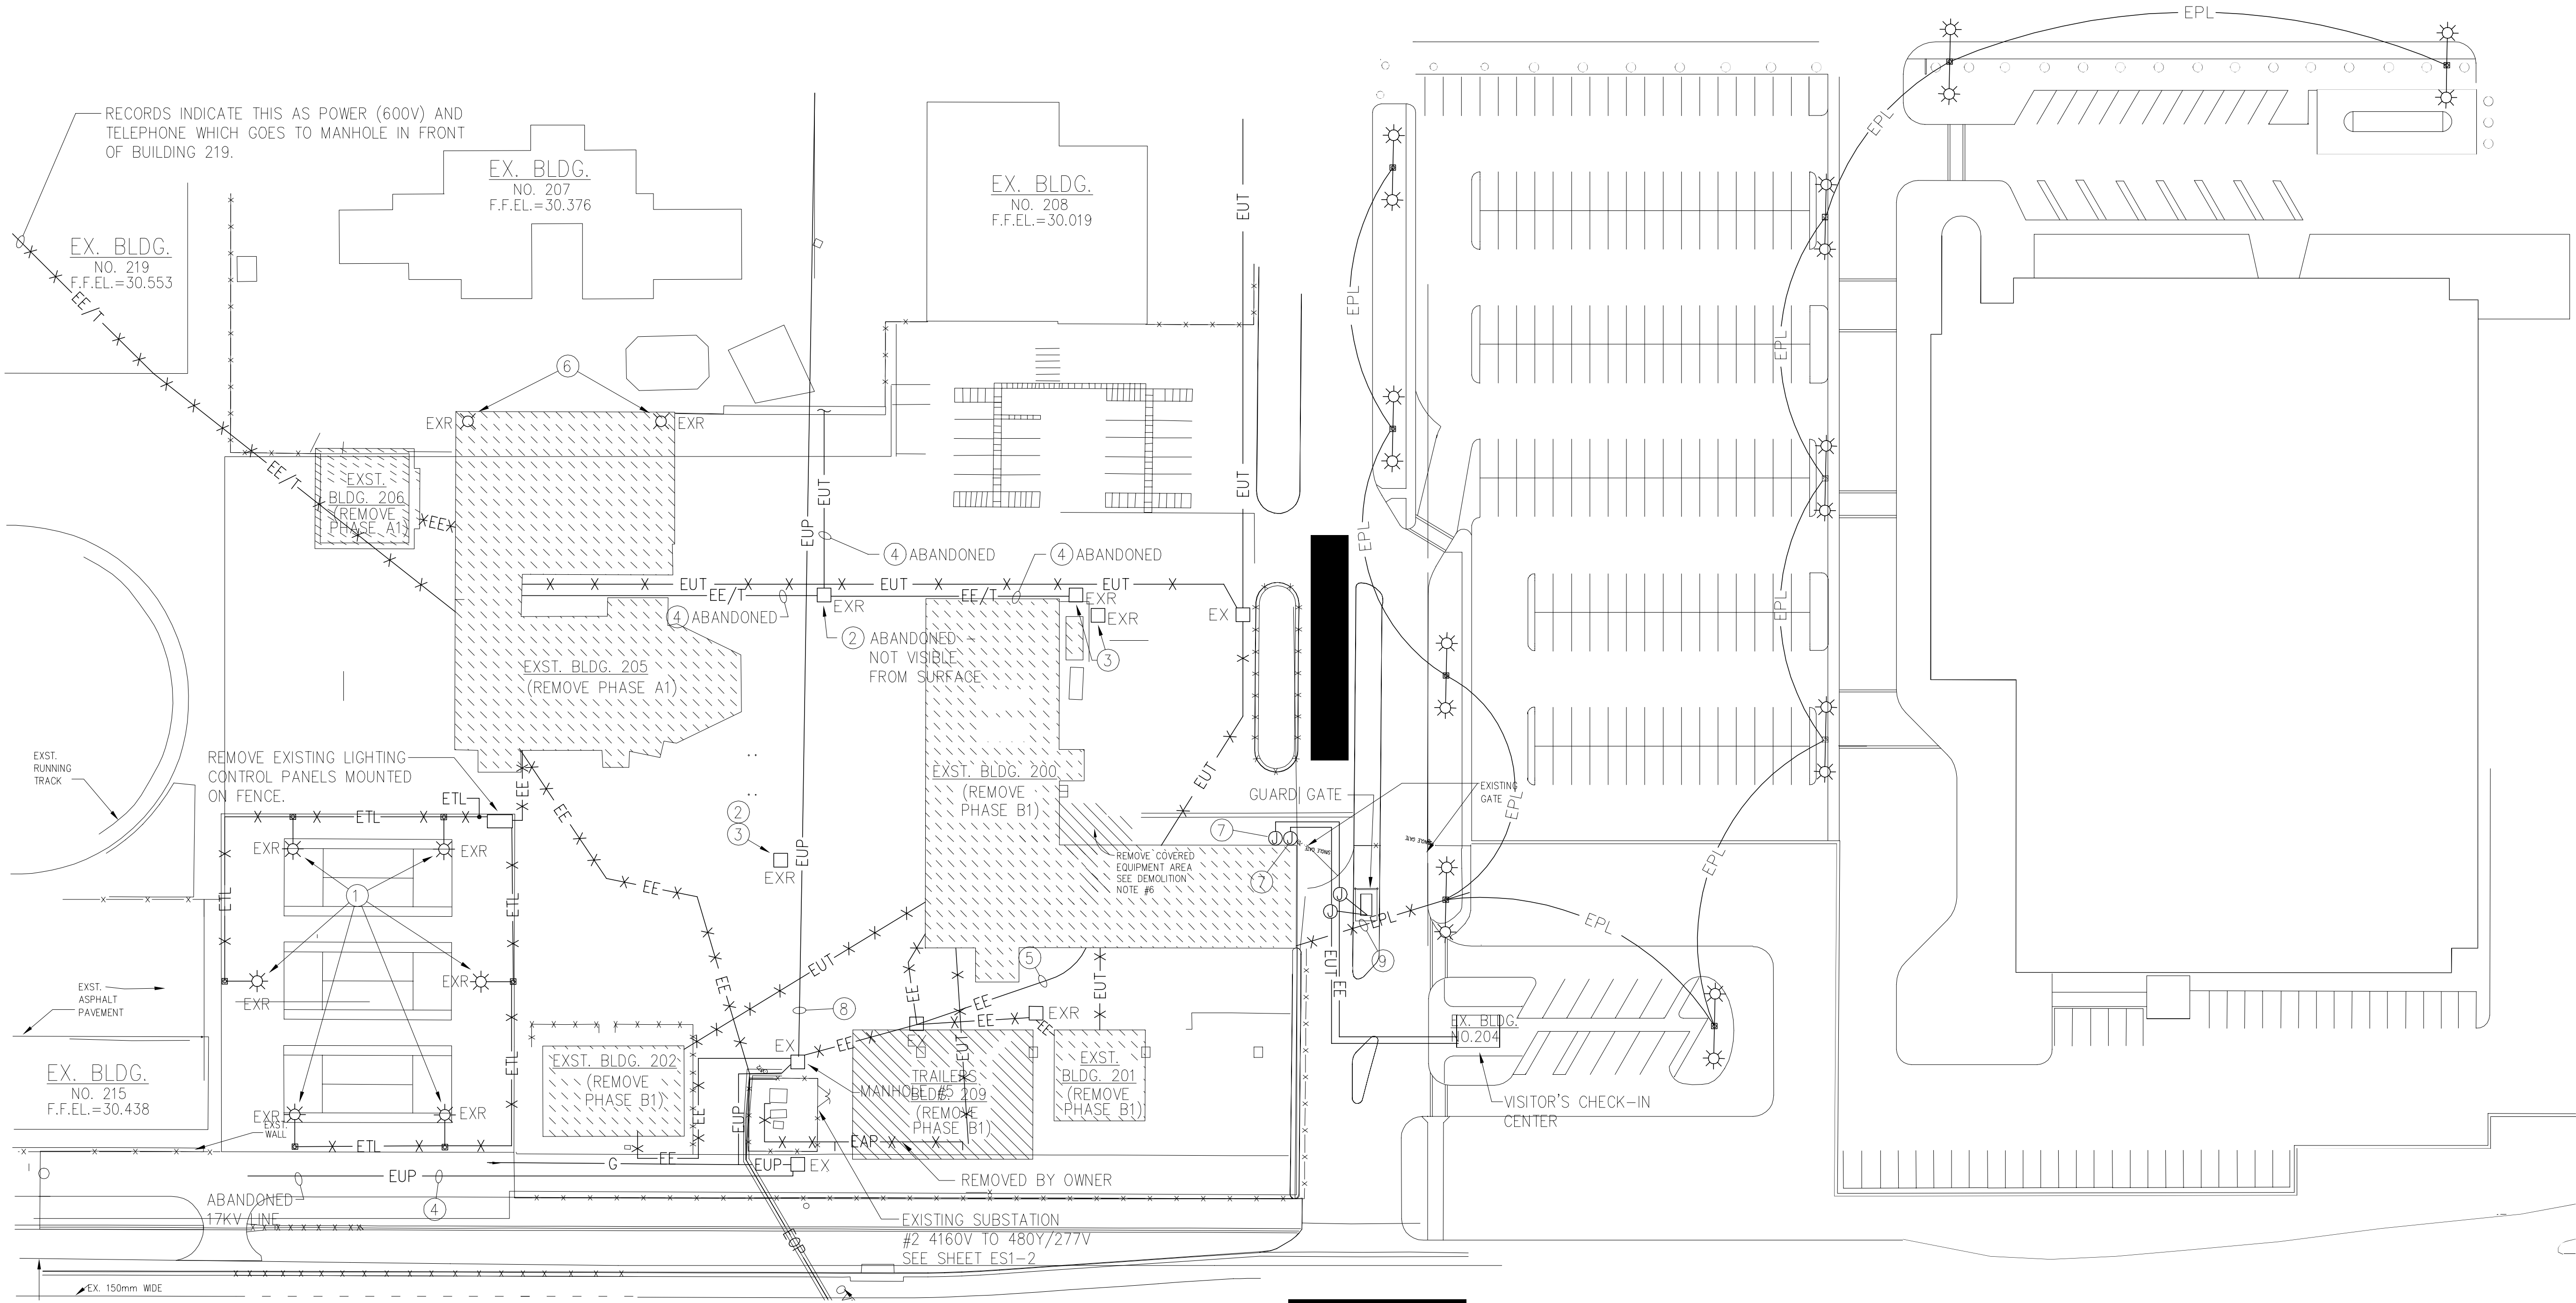

- EXISTING TENNIS COURT LIGHT FIXTURE, POLE, AND POLE BASE SHALL BE REMOVED. TURN OVER TO BASE FOR SALVAGE.
- EXISTING ABANDONED HANDHOLE REMOVE CABLES AND OR TELEPHONE CABLES. CONTRACTOR SHALL VERIFY IF ANY CABLES ARE ENERGIZED BEFORE REMOVAL.
- NO EXISTING CABLES IN HANDHOLE – DEMOLISH HAND HOLE.
- RECORDS INDICATE ABANDONED CABLES WHERE NOTED.
- RECORDS INDICATE 600 VOLT CABLE. CONTRACTOR SHALL VERIFY. LEAVE IN SERVICE UNTIL NEW CLINIC IS CONSTRUCTED.
- REMOVE EXISTING ROOF MOUNTED LIGHTS. TURN OVER TO BASE FOR SALVAGE.
- POWER AND TELEPHONE TO GUARD GATE AND VISITORS CENTER TO REMAIN IN SERVICE FROM EXISTING CLINIC UNTIL NEW CLINIC IS CONSTRUCTED. WHEN NEW CLINIC IS CONSTRUCTED REMOVE SURFACE MOUNTED CONDUITS FROM EXISTING CLINIC EXTERIOR BACK TO BELOW GRADE AND PROVIDE NEW HANDHOLE FOR NEW FEEDS TO PICK-UP EXISTING CIRCUITS PRIOR TO DEMOLISHING OLD CLINIC.
- TWO PARALLEL DUCT BANKS OUT OF MANHOLE #5. SEE POWER PLAN EXISTING SUBSTATION NO. 2, SHEET ES1-2.
- EXISTING UNDERGROUND LIGHTING CIRCUITS TO REMAIN IN SERVICE UNTIL NEW FEEDER IS INSTALLED FROM COMMISSARY.

AREA "B"
ELECTRICAL SITE PLAN - DEMOLITION
SCALE: 1: 500
1:500 10 0 10 20 30 40 50 METERS
GRAPHIC SCALE
(IN METERS)

REMOVE	TO REMAIN	LEGEND
— EUT —	— EUT —	EXISTING UNDERGROUND TELEPHONE/DATA
— EPL —	— EPL —	EXISTING UNDERGROUND PARKING LOT LIGHTING CIRCUIT
□ EXR	□ EX	EXISTING HANDHOLE OR MANHOLE
— ETL —	— ETL —	EXISTING TENNIS COURT LIGHTING CIRCUIT
— EAP —	— EAP —	EXISTING ABOVE GROUND POWER
EXR □	☀ □	EXISTING PARKING LIGHT OR TENNIS COURT LIGHTING STANDARD.
	— EUP —	EXISTING UNDERGROUND PRIMARY POWER
	— G —	EXISTING GUY WIRE
— EE —	— EE —	EXISTING UNDERGROUND SECONDARY POWER
	— EE/T —	EXISTING UNDERGROUND SECONDARY AND TELEPHONE
	— EOP —	EXISTING OVERHEAD PRIMARY
		EXISTING FLOOD LIGHT

IF SHEET IS LESS THAN 28"x42", IT IS A REDUCED PRINT. SCALE REDUCED ACCORDINGLY.

ES1-1

MEDICAL/DENTAL CLINIC

ELECTRICAL SITE PLAN – DEMOLITION

SIZE	CODE IDENT. NO.	DRAWING NO.
F	XXXXX	8144759
SCALE:	AS SHOWN	SPEC. 11996048
		SHEET 254 OF 316