


REVISIONS				
SYM	DESCRIPTION	PREPARED BY	DATE	APPROVED

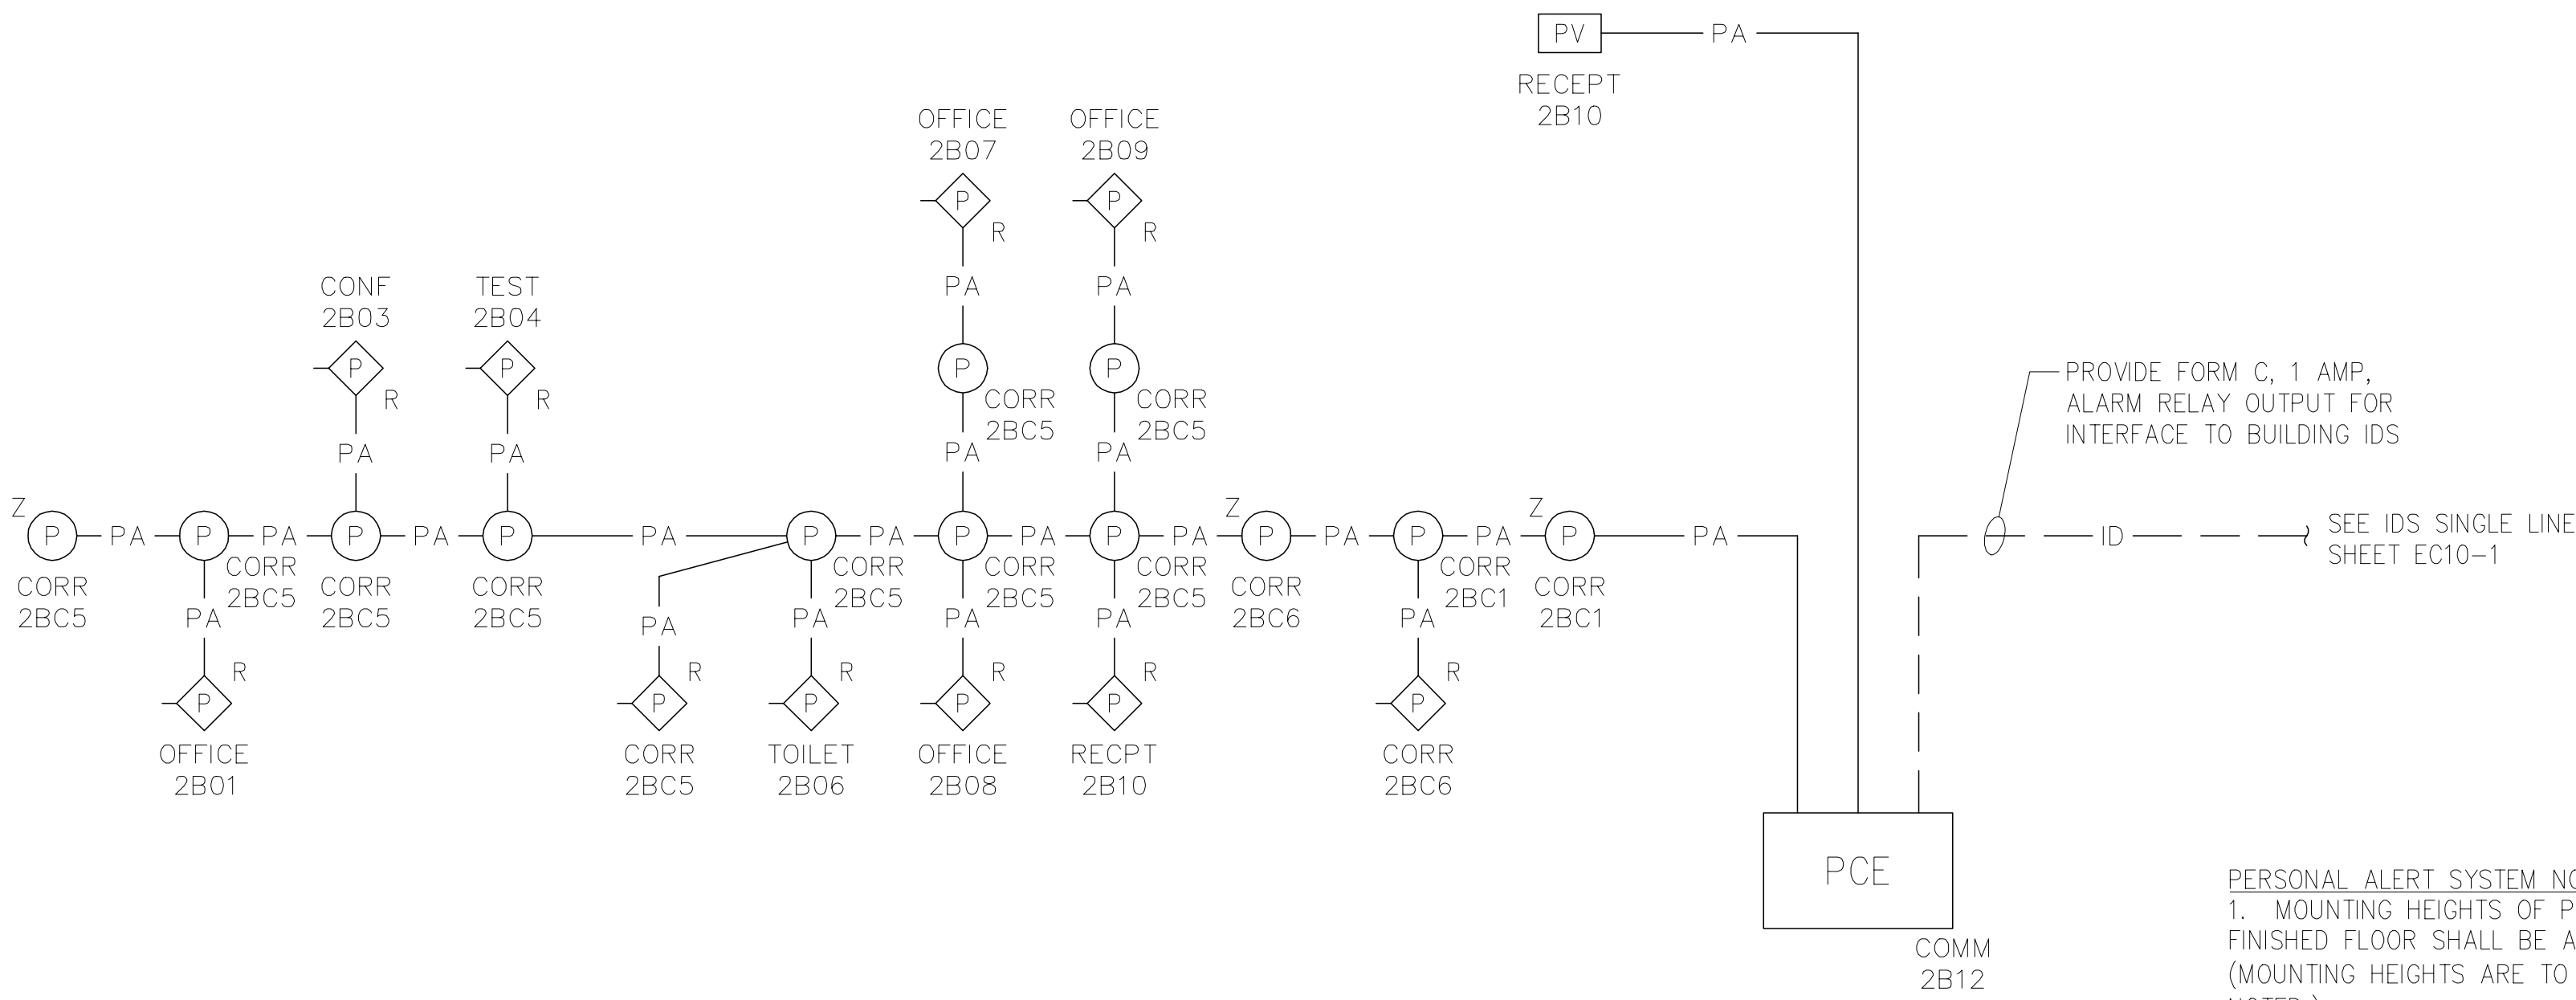

PERSONAL ALERT SYSTEM NOTES:
1. MOUNTING HEIGHTS OF PERSONAL ALERT SYSTEM DEVICES ABOVE FINISHED FLOOR SHALL BE AS FOLLOWS, UNLESS OTHERWISE NOTED. (MOUNTING HEIGHTS ARE TO CENTERLINE OF DEVICE, EXCEPT WHERE NOTED.)

CONTROL EQUIPMENT CABINET.....1676mm TO TOP OF CABINET
ANNUNCIATOR PANEL.....1676mm TO TOP OF DISPLAY
RECEIVER.....1828mm

**SINGLE LINE DIAGRAM -
PERSONAL ALERT SYSTEM**
NO SCALE

IF SHEET IS LESS THAN 28"x42", IT IS A REDUCED PRINT. SCALE REDUCED ACCORDINGLY.

EC8-2

MEDICAL/DENTAL CLINIC			
PERSONAL ALERT SYSTEM – SINGLE LINE DIAGRAM			
SIZE	CODE IDENT. NO.	DRAWING NO.	
F	XXXXX	8144817	
SCALE: AS SHOWN		CONST. CONTR. NO.	
		SPEC. 11996048	SHEET 312 OF 316