


REVISIONS				
SYM	DESCRIPTION	PREPARED BY	DATE	APPROVED


THIS DETAIL IS FOR AREA CLASSIFICATION AND SEAL OFFS ONLY  
SEE OTHER DRAWINGS FOR MEMBRANE VENT PIPING ETC.

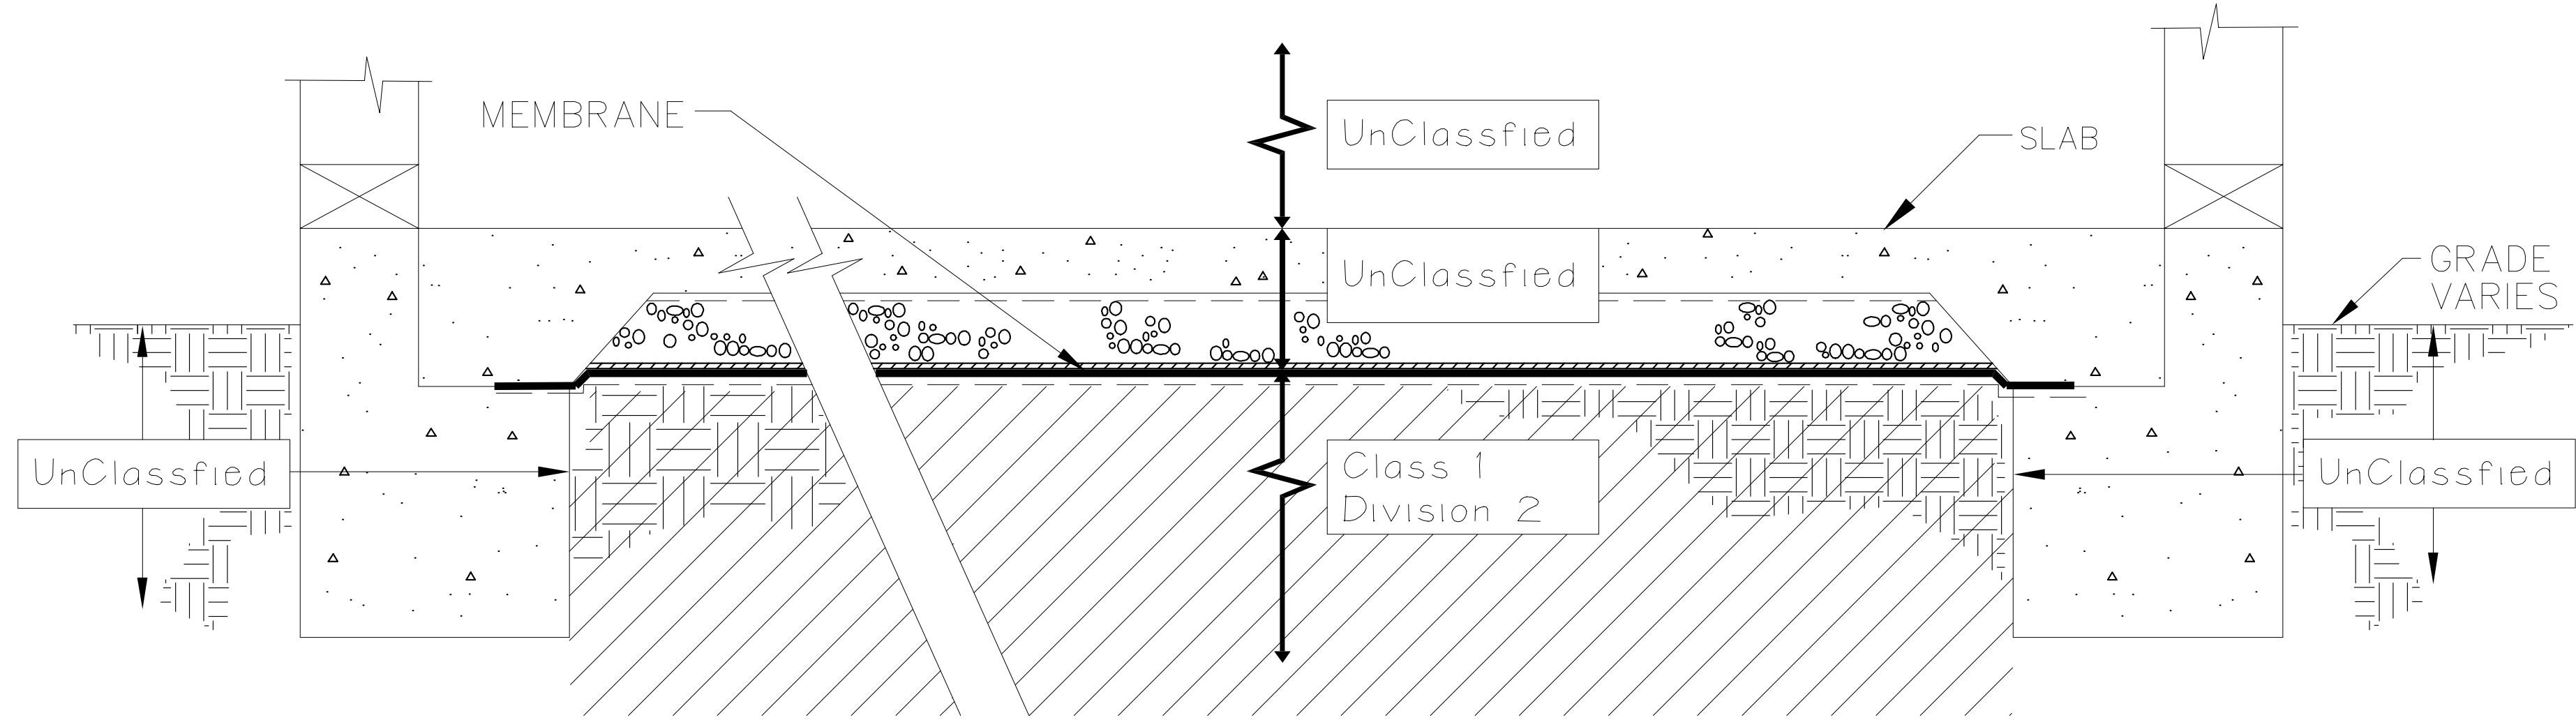

MEDICAL/DENTAL CLINIC  
CLASSIFICATIONS

NOT TO SCALE  
59  
GC-11 GC-11


THIS DETAIL IS FOR AREA CLASSIFICATION AND SEAL OFFS ONLY  
SEE OTHER DRAWINGS FOR MEMBRANE VENT PIPING ETC.

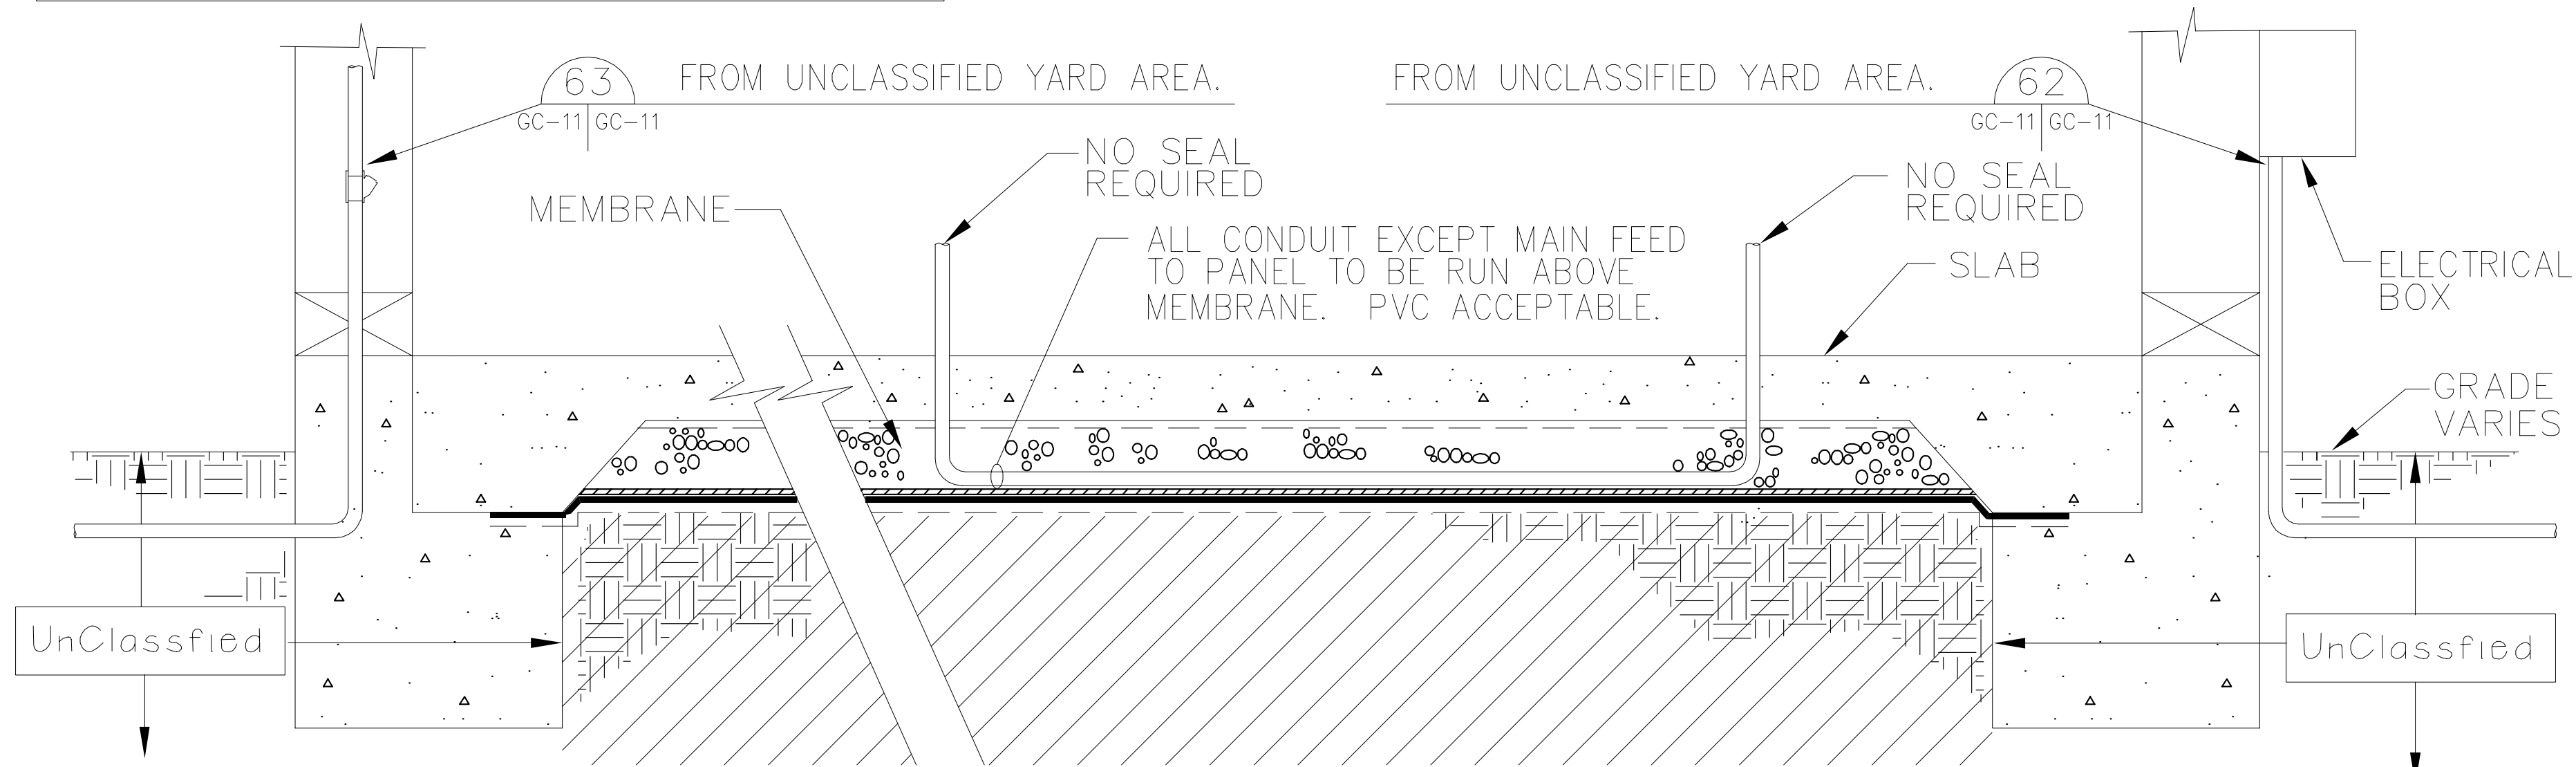

MEDICAL/DENTAL CLINIC  
CONDUIT THROUGH UNCLASSIFIED

NOT TO SCALE  
50  
GC-11 GC-11


THIS DETAIL IS FOR AREA CLASSIFICATION AND SEAL OFFS ONLY  
SEE OTHER DRAWINGS FOR MEMBRANE VENT PIPING ETC.

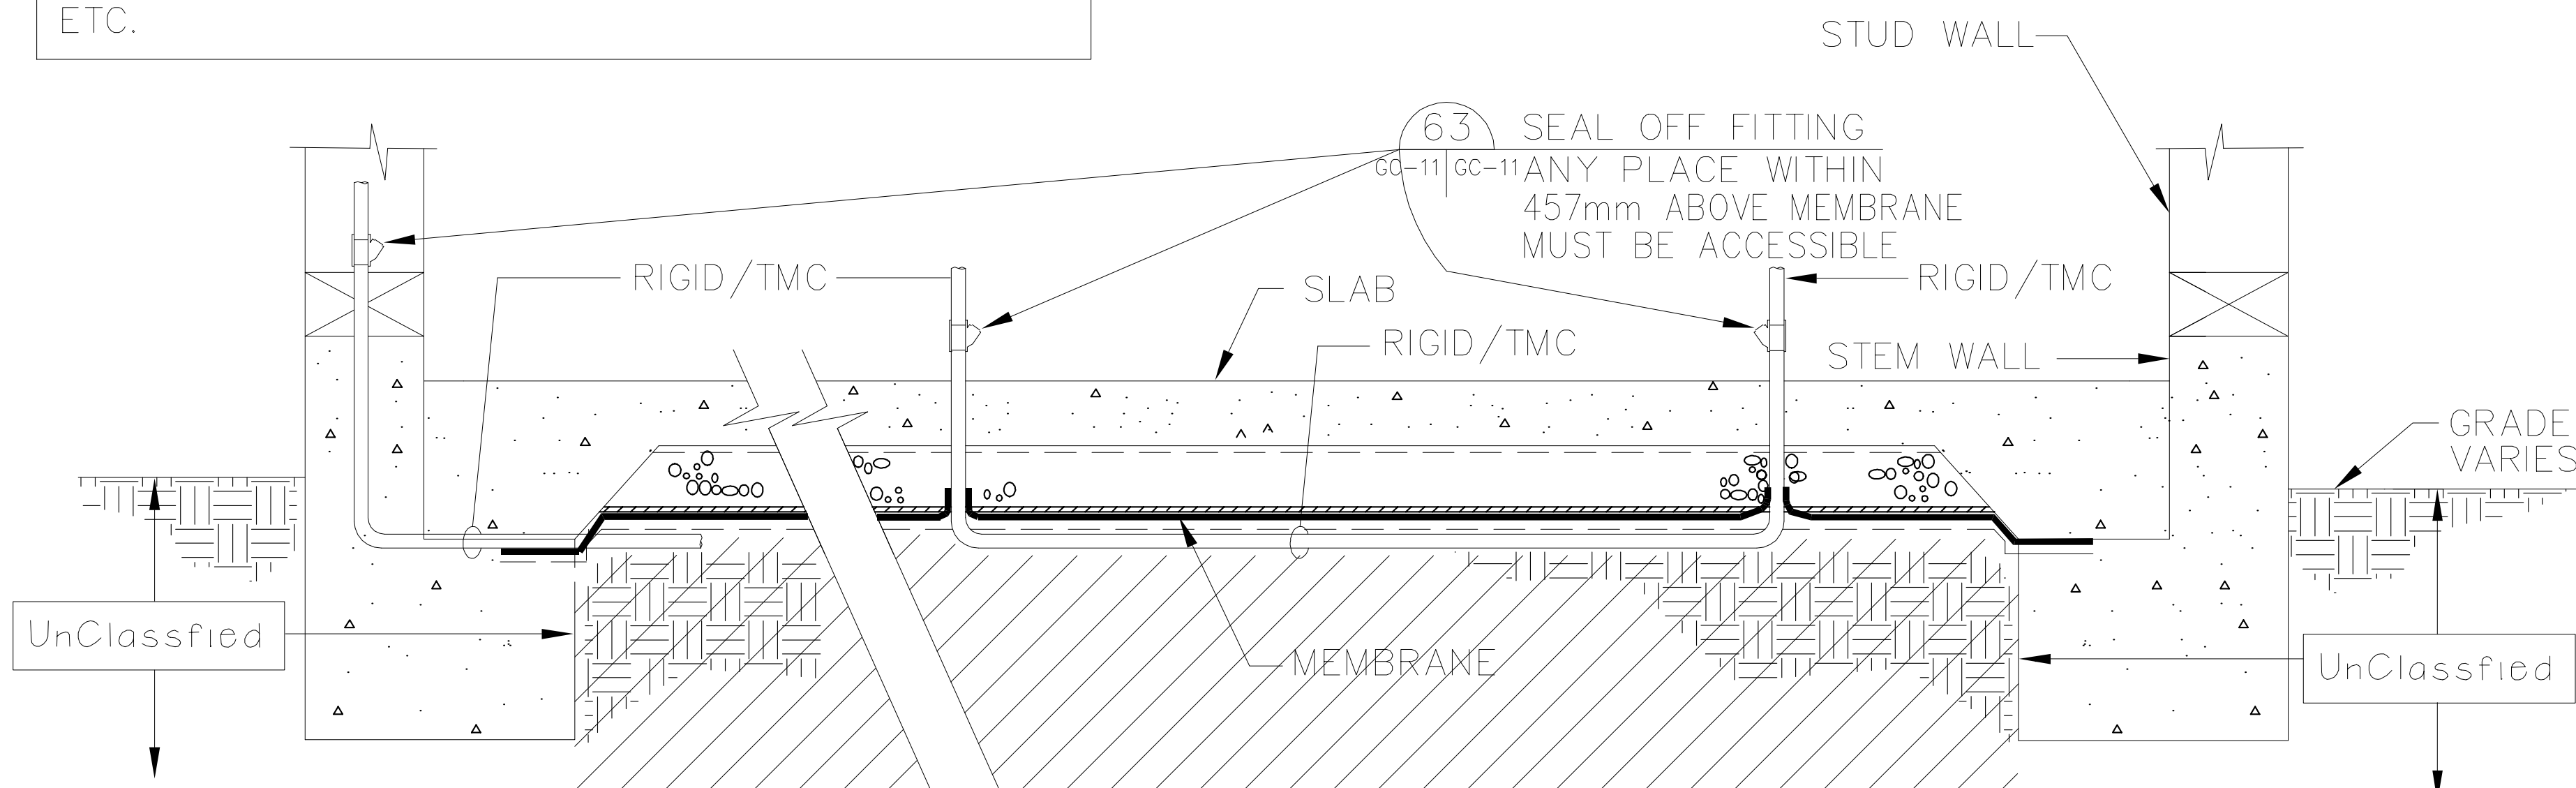

MEDICAL/DENTAL CLINIC  
CONDUIT THROUGH CLASS 1 DIVISION 2

NOT TO SCALE  
61  
GC-11 GC-11


FIBRE DAM AND CHICO MAY BE INSTALLED IN THE PLAIN END OF THE CONDUIT WHERE THE UTILITY SERVICE ENTERS THE MAIN PANEL. THIS WORK MUST BE COORDINATED WITH THE ELECTRICAL UTILITY COMPANY TO BE ACCOMPLISHED PRIOR TO THEIR TAGGING OUT THE PANELS.

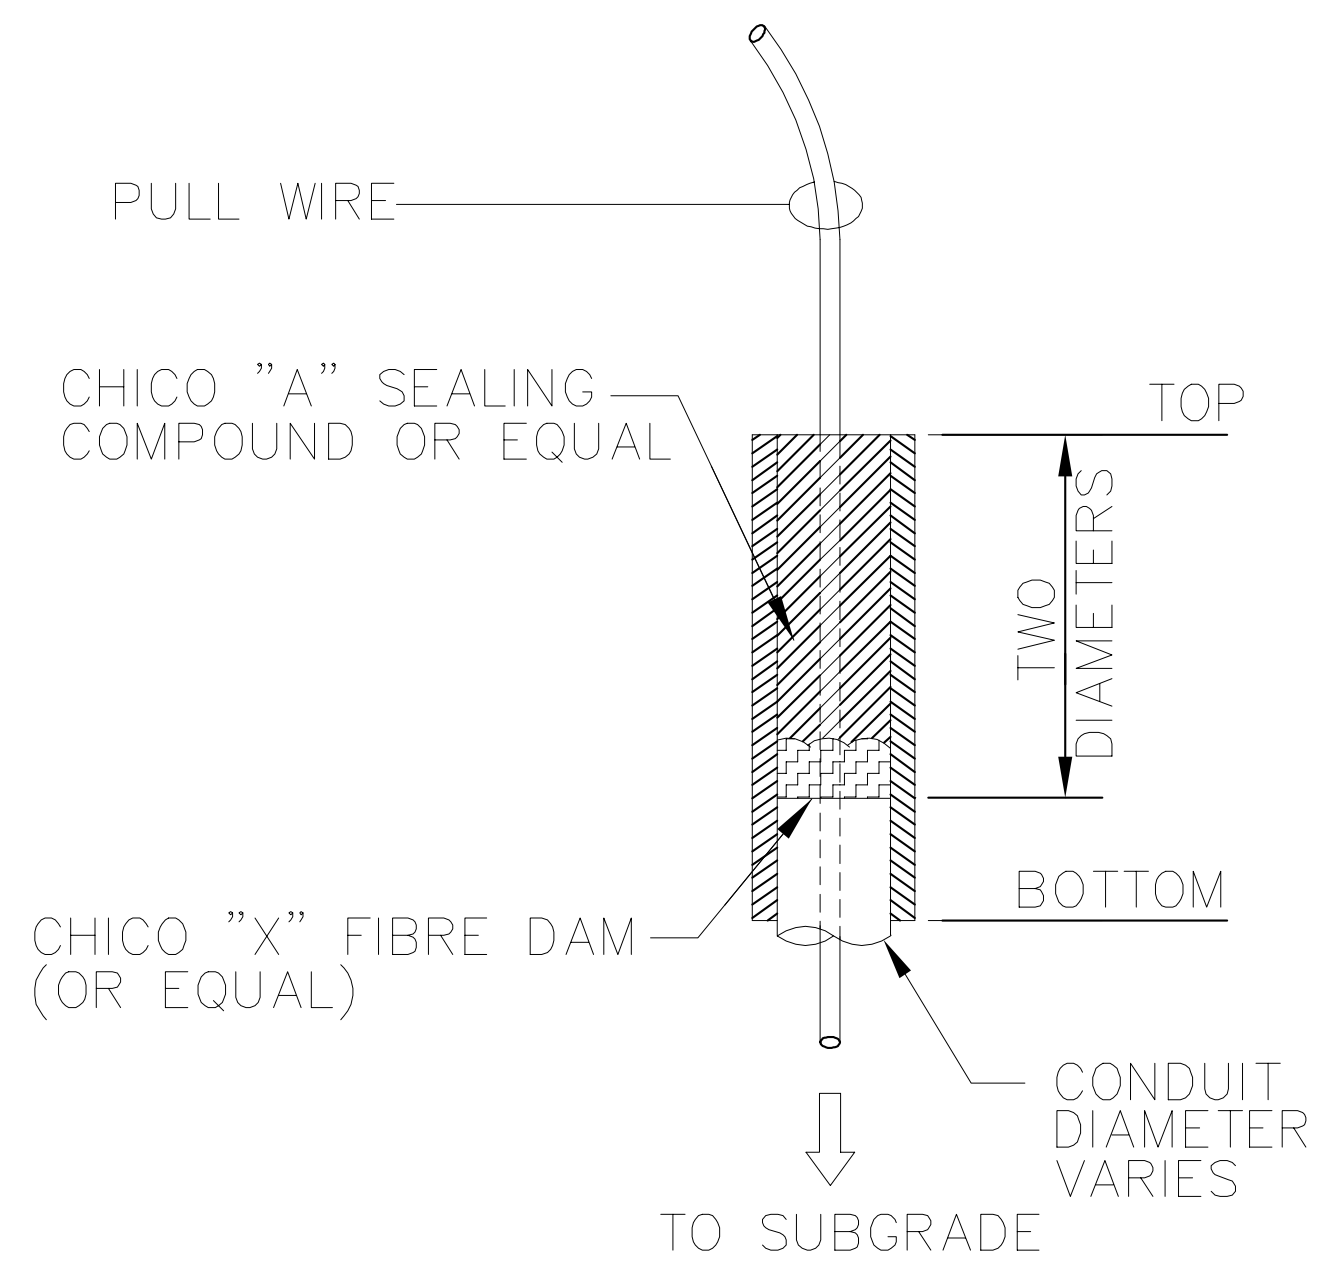

END SEAL FOR USE W/ PVC OR RIGID

MEDICAL/DENTAL CLINIC  
END SEAL

NOT TO SCALE  
62  
GC-11 GC-11

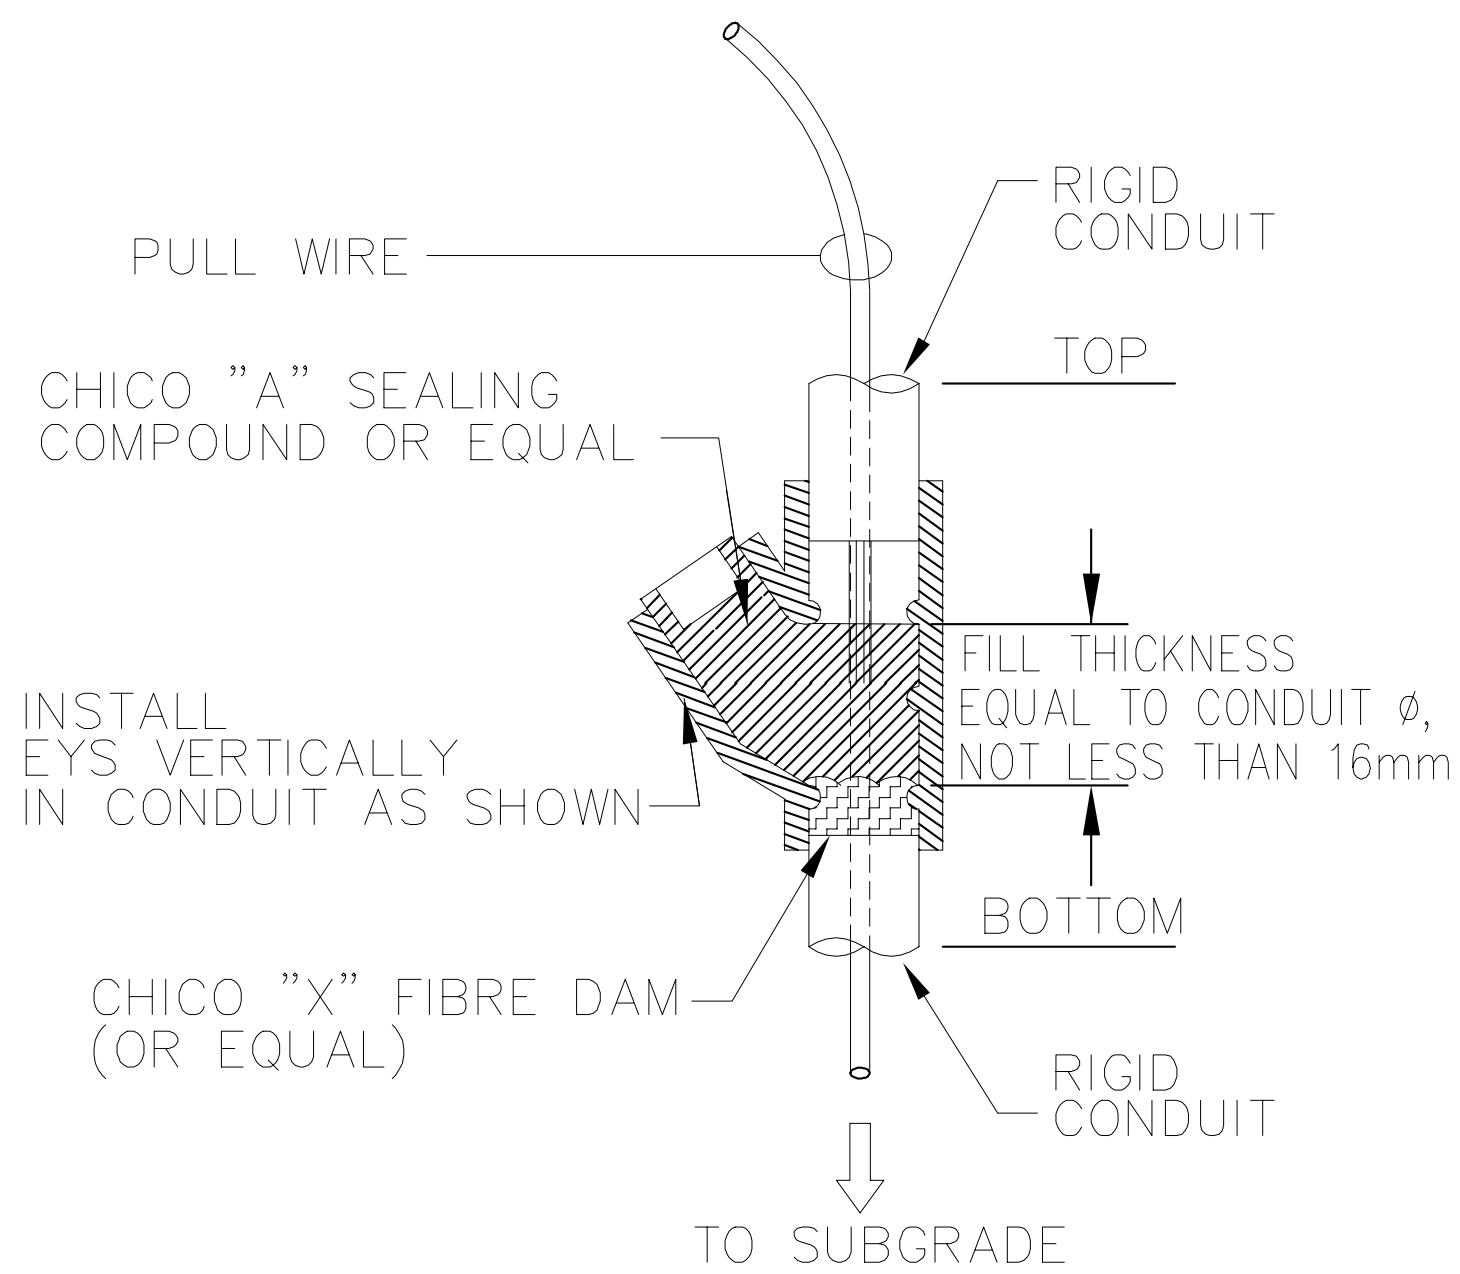


WYE SEAL FOR USE WITH RIGID CONDUIT

MEDICAL/DENTAL CLINIC  
WYE SEAL

NOT TO SCALE  
63  
GC-11 GC-11

ONLY ONE METHOD OF SEAL-OFF IS REQUIRED

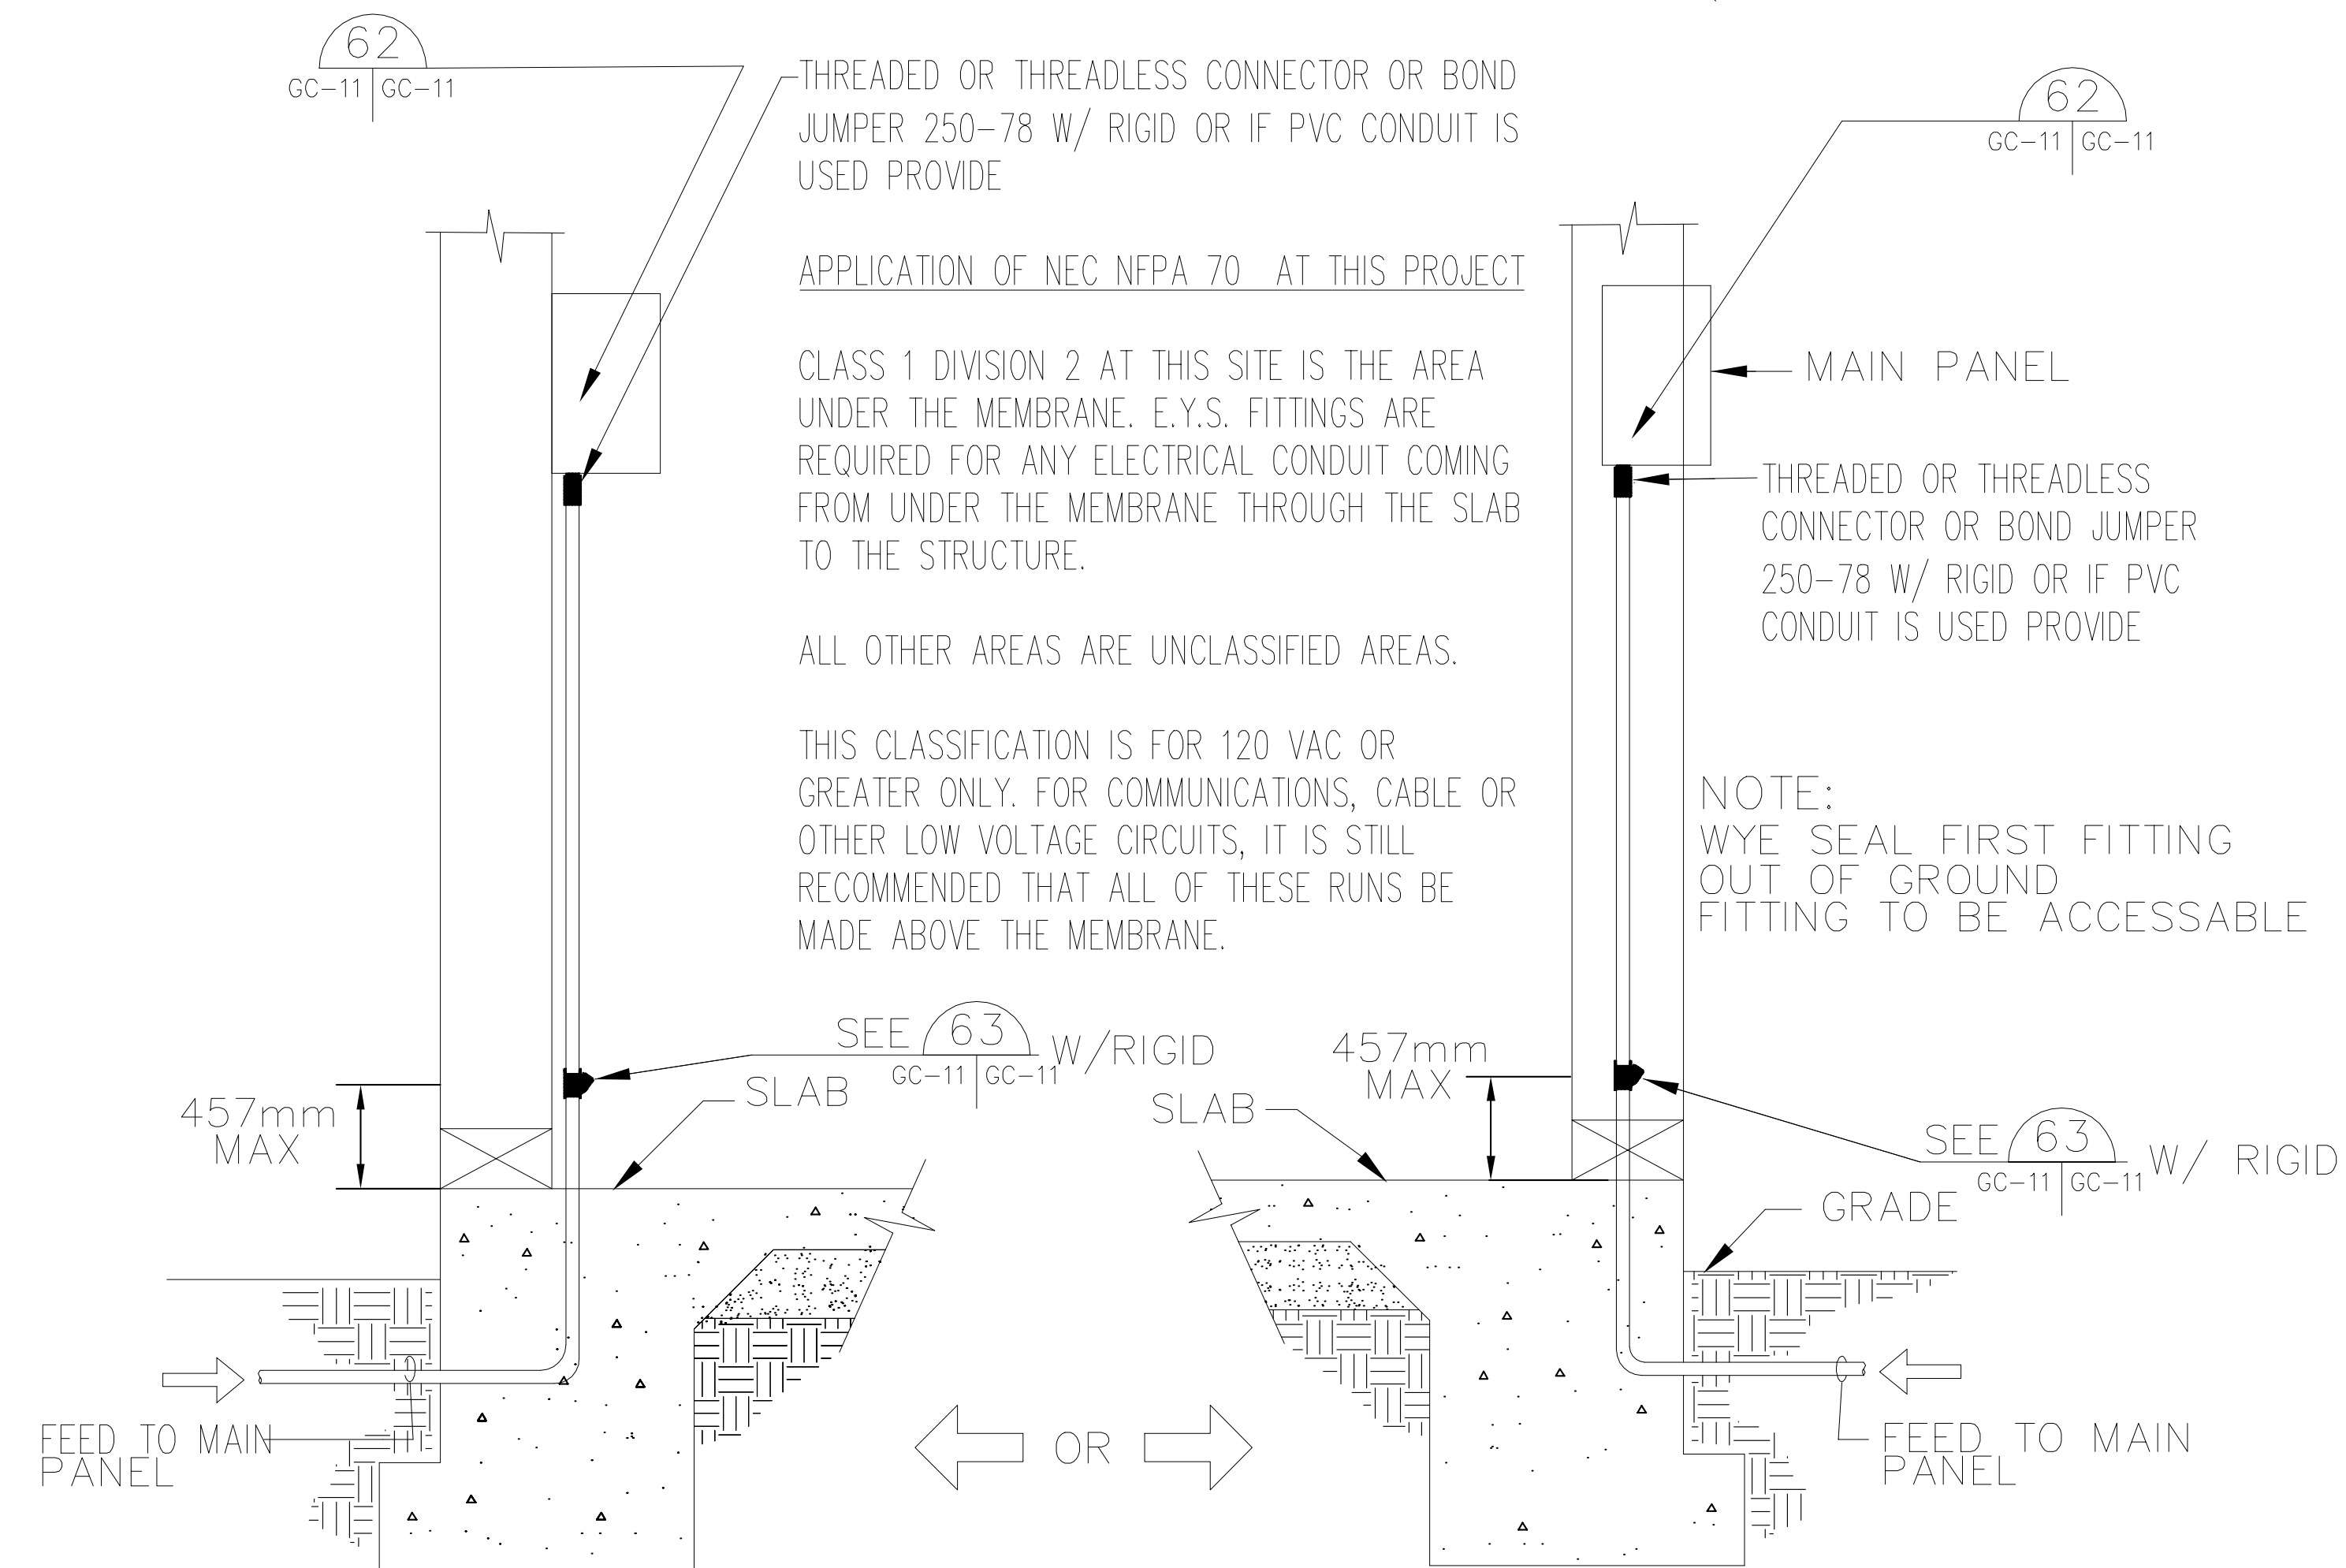

ONLY ONE METHOD OF SEAL-OFF IS REQUIRED

MEDICAL/DENTAL CLINIC  
GROUT UTILITY POWER FEED

NOT TO SCALE  
64  
GC-11 GC-11

IF SHEET IS LESS THAN 28"x42", IT IS A REDUCED PRINT. SCALE REDUCED ACCORDINGLY.

GC-11

MEDICAL/DENTAL CLINIC

CLASSIFIED AREAS

SIZE	CODE IDENT. NO.	DRAWING NO.
F	XXXXX	8144535
SPEC.	CONSTR. CONTR. NO.	