

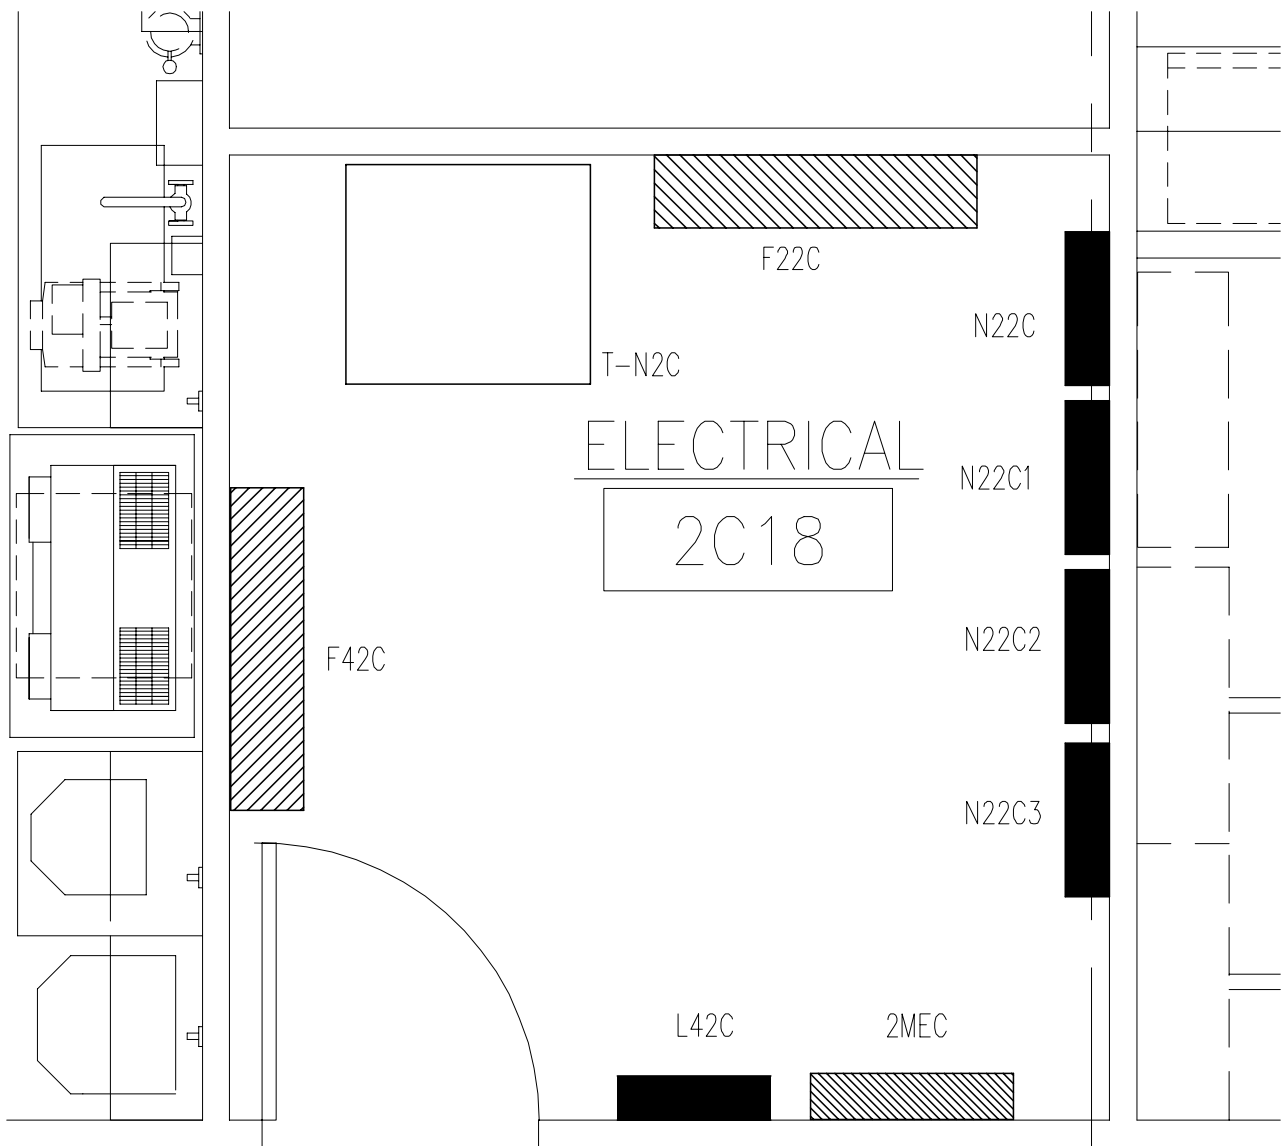


REVISIONS				
SYM	DESCRIPTION	PREPARED BY	DATE	APPROVED

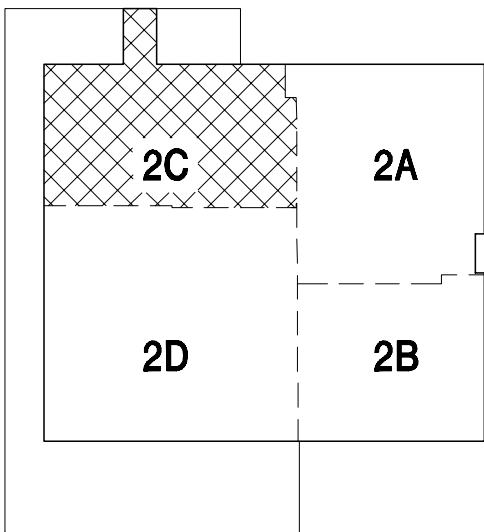

ELECTRICAL ROOM
LAYOUT - BLOCK 2C

SCALE: 1:25

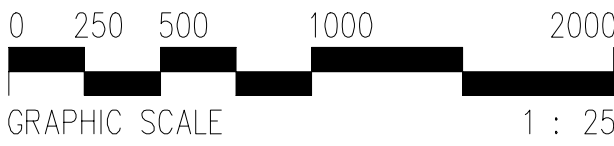


2ND FLOOR
BLOCK 2C
KEY PLAN



POWER
SECOND FLOOR PLAN
BLOCK 2C

SCALE: 1:50

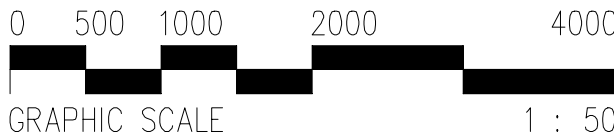

IF SHEET IS LESS THAN 28"x42", IT IS A REDUCED PRINT. SCALE REDUCED ACCORDINGLY.

EP2-11

MEDICAL/DENTAL CLINIC

POWER - SECOND FLOOR PLAN - BLOCK 2C

SIZE	CODE IDENT. NO.	DRAWING NO.
F	XXXXX	8144788
SCALE:	AS SHOWN	SHEET 283 OF 316

NOTES:

- FOR D4500 UNIT. MOUNT RECEPTACLE @1500mm, AFF.
- FOR D3560 - POLYMERIZATION UNIT. MOUNT RECEPTACLE BELOW COUNTER @ 460mm AFF.
- 208V, 1Ø RECEPTACLE FOR STERILIZER CONNECTION. COIL "C" PHASE CONDUCTOR IN GANG BOX FOR FUTURE USE. RESERVE SINGLE POLE BREAKER SPACE FOR FUTURE 3-POLE CIRCUIT BREAKER. SEE PANEL N22C2, SHEET EP5-5.
- BUCK-BOOSTER TRANSFORMERS MOUNTED ABOVE ACCESSIBLE CEILING. PROVIDE UNISTRUT OR RACK SUPPORT. TRANSFORMERS PROVIDED BY GOVERNMENT, INSTALLED BY CONTRACTOR.
- COORDINATE MOUNTING LOCATION OF COUNTER TOP RECEPTABLES WITH LOCATION OF STERILIZER RECEPTACLE TO BE MOUNTED OFF TO THE SIDE OF STERILIZER MOUNT 1200mm DOWN FROM NORTH WALL.
- CIRCUIT TO SHUNT TRIP CIRCUIT BREAKER IN PANEL.
- BOILER CONTROLS, 120 VOLTS.