



REVISIONS				
SYM	DESCRIPTION	PREPARED BY	DATE	APPROVED

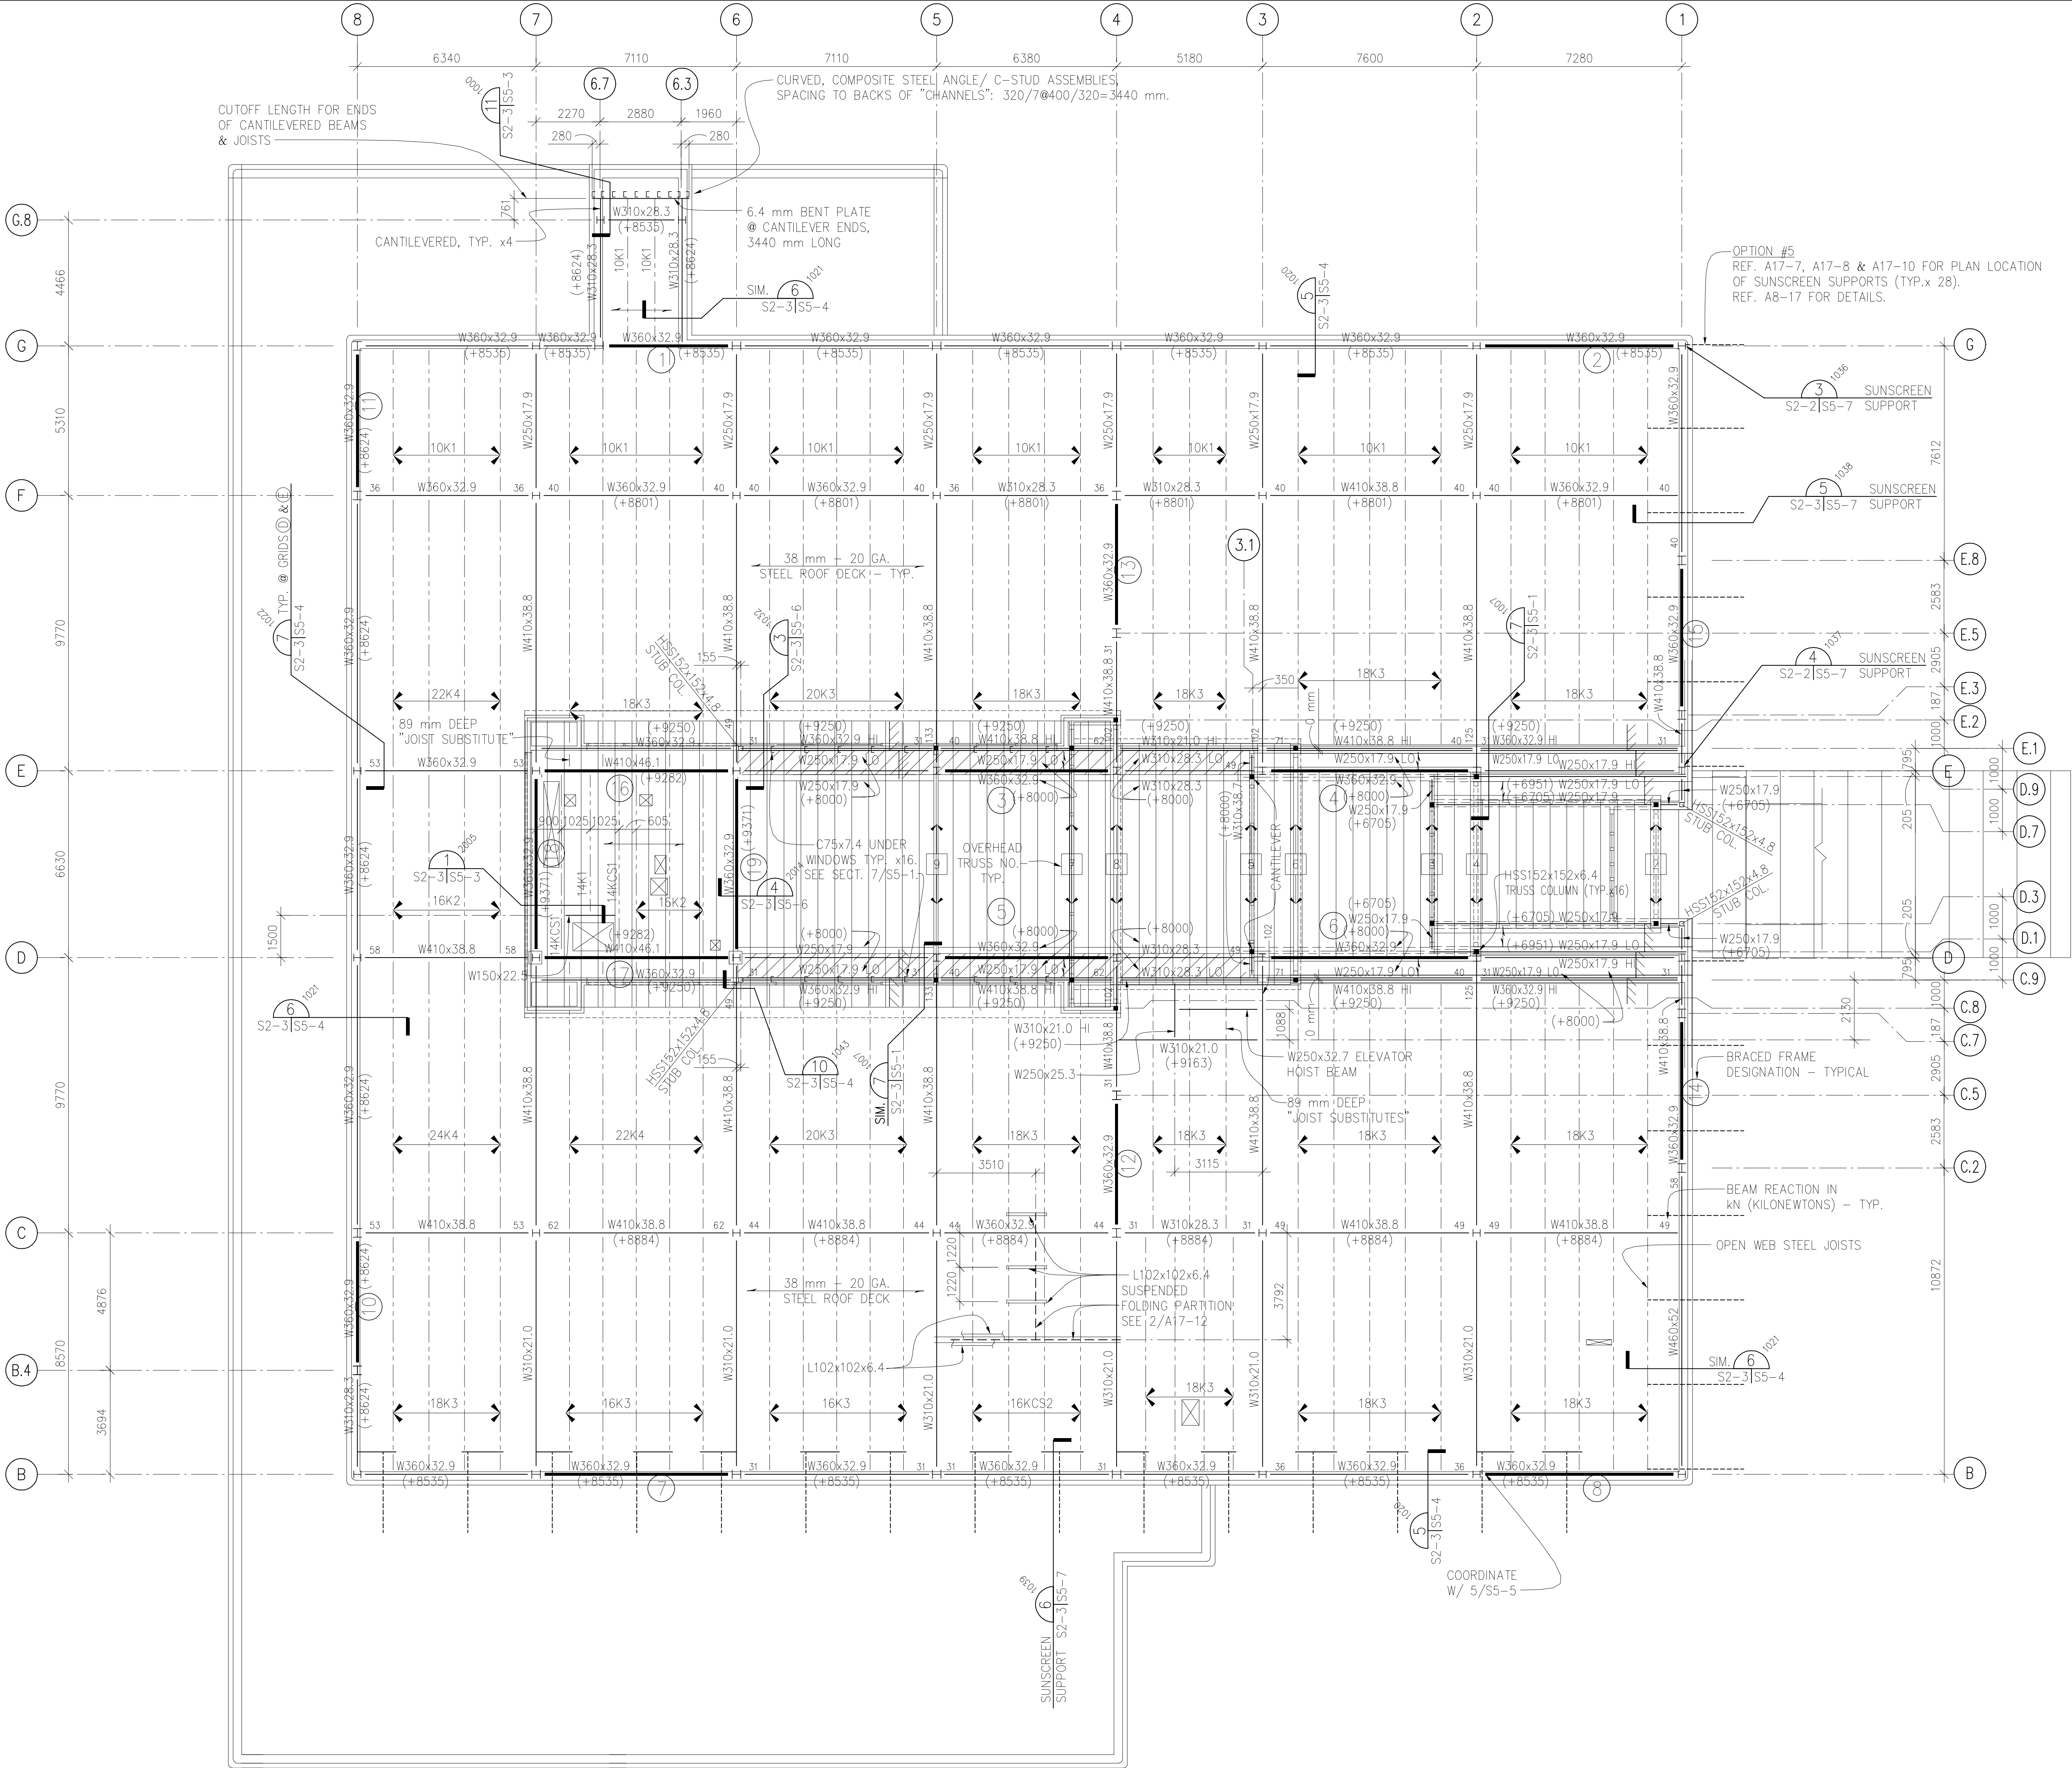

- NOTES:**
- ROOF IS SLOPED TO ACCOMMODATE DRAINAGE TO PERIMETER.
 - ELEVATIONS SHOWN, E.G. (+8884), ARE FOR TOPS OF STEEL BEAMS RELATIVE TO FINISH FIRST FLOOR SLAB ELEVATION (30.50 m = +0). BEAMS WITHOUT CALLOUTS ARE SLOPED. STEEL ELEVATIONS ARE BASED ON 89 mm (3½") JOIST BEARING DEPTHS.
 - SEE S1 SHEETS FOR GENERAL NOTES, AND LEGEND.
 - HOUSEKEEPING PADS NOT SHOWN. SEE MECHANICAL, ELECTRICAL, AND PLUMBING DRAWINGS FOR EQUIPMENT SIZES AND LOCATIONS. SEE TYPICAL HOUSEKEEPING PAD ON S1-1.
 - STEEL JOISTS SHALL BE SPACED EVENLY WITHIN BAYS INDICATED, UNLESS SHOWN OTHERWISE.



MAIN ROOF FRAMING PLAN
SCALE: 1 : 100
0 1000 2000 4000 8000
GRAPHIC SCALE 1 : 100

IF SHEET IS LESS THAN 28"x42", IT IS A REDUCED PRINT, SCALE REDUCED ACCORDINGLY.

S2-3

MEDICAL/DENTAL CLINIC			
MAIN ROOF FRAMING PLAN			
SIZE	CODE IDENT. NO.	DRAWING NO.	8144673
F	XXXXX	CONST. CONTR. NO.	
SCALE: AS SHOWN	SPEC. 11996048	SHEET 168 OF 316	