

REVISIONS				
SYM	DESCRIPTION	PREPARED BY	DATE	APPROVED

INTRUSION DETECTION SYSTEM NOTES:


1. MOUNTING HEIGHTS OF INTRUSION DETECTION SYSTEM DEVICES ABOVE FINISHED FLOOR SHALL BE AS FOLLOWS, UNLESS OTHERWISE NOTED. (MOUNTING HEIGHTS ARE TO CENTERLINE OF DEVICE, EXCEPT WHERE NOTED).

CONTROL PANEL.....1676mm TO TOP OF DISPLAY
KEYBOARD.....1422mm
CARD READER.....1422mm
ALARM HORN.....2280mm
ALARM VISUAL.....2280mm
PASSIVE IR DET.....2286mm

2. ALL WIRING SHALL BE IN CONDUIT, 16mm MINIMUM.


3. DOOR SWITCHES TO BE MOUNTED IN TOP OF DOOR FRAME.

4. ALL TERMINAL CABINETS SHALL BE STEEL, NEMA 1, STEEL HINGED DOOR, WITH FIRE PROOF PAINTED WOOD BACKBOARD AND BARRIER TYPE TERMINAL STRIPS.

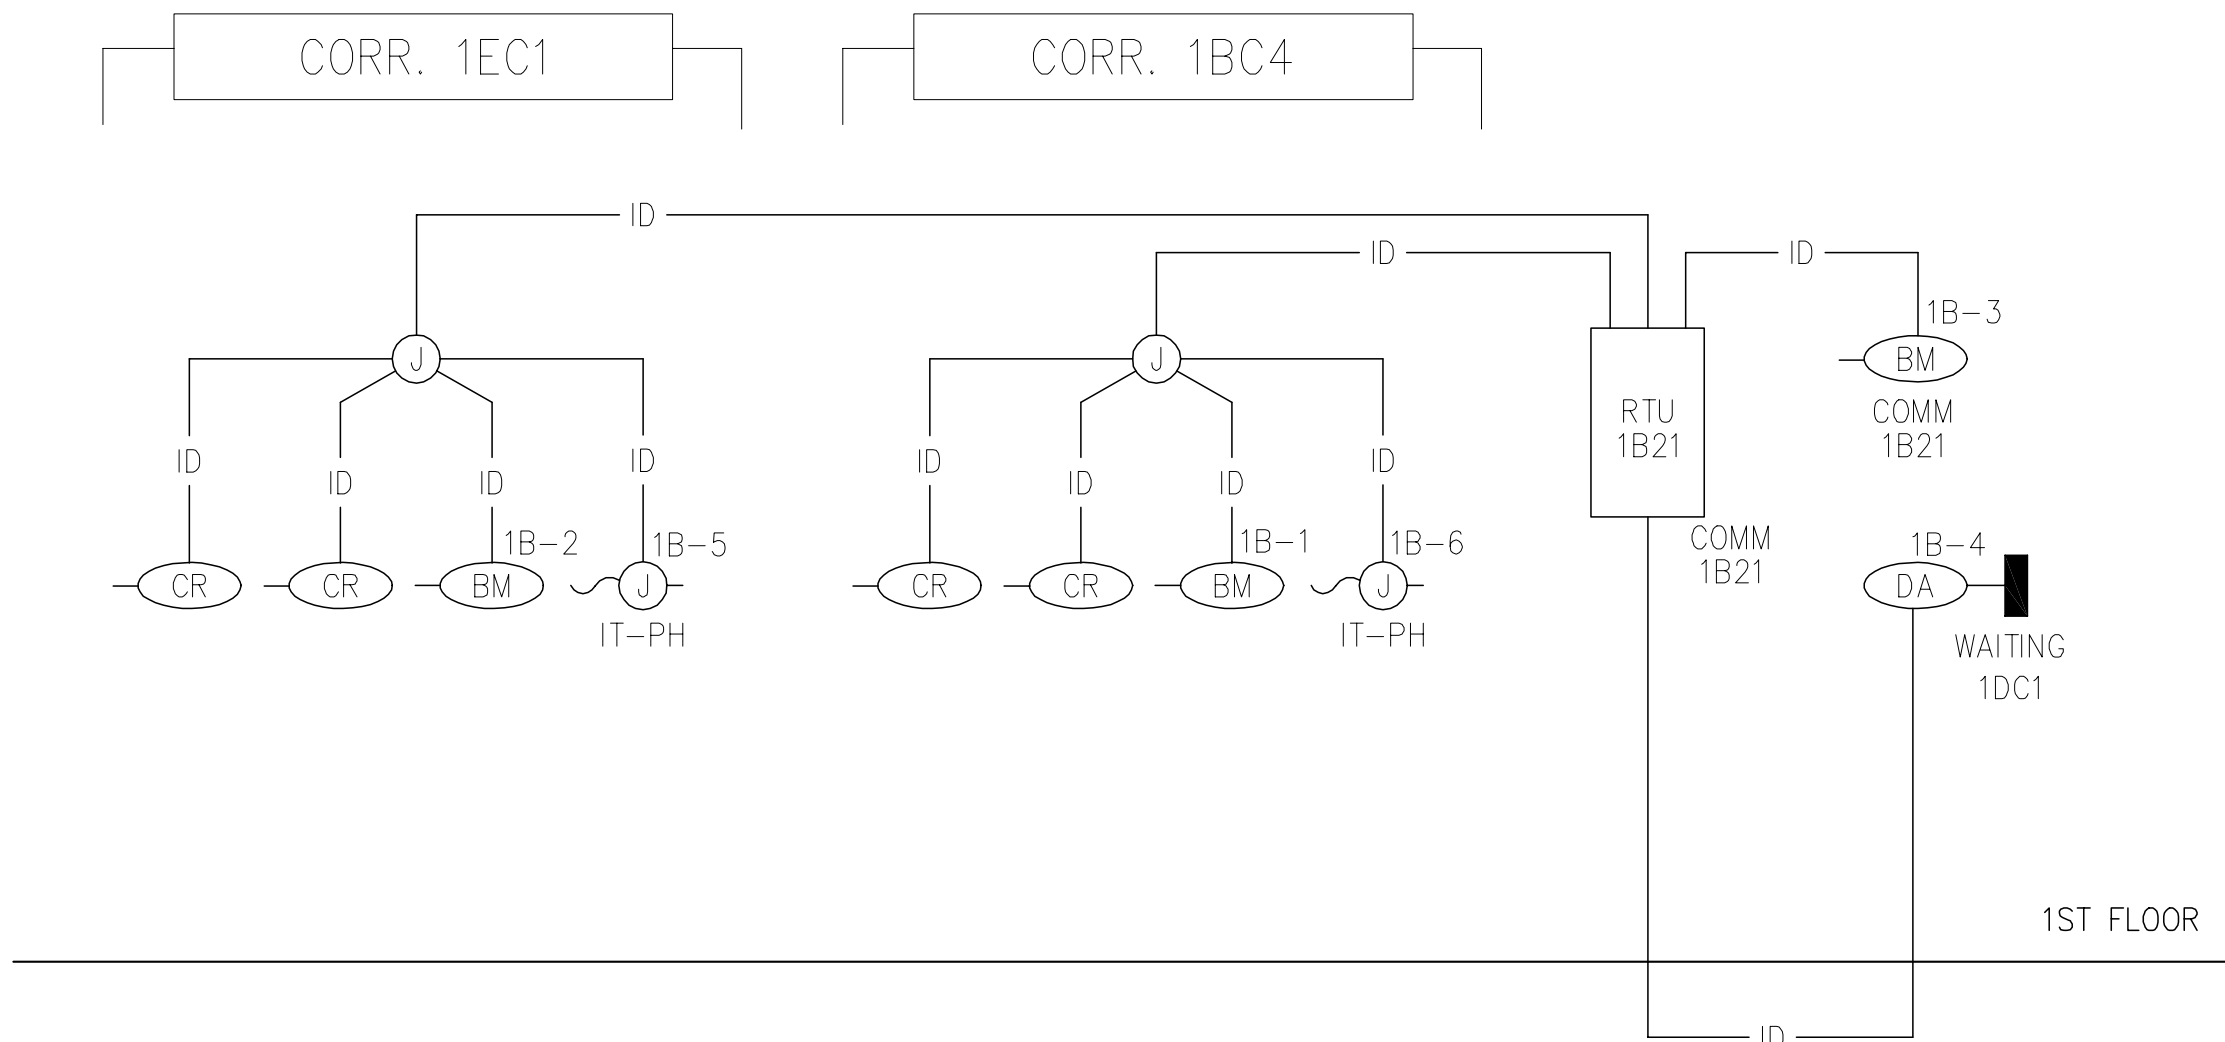

SINGLE LINE DIAGRAM
RTU-1B21

NO SCALE

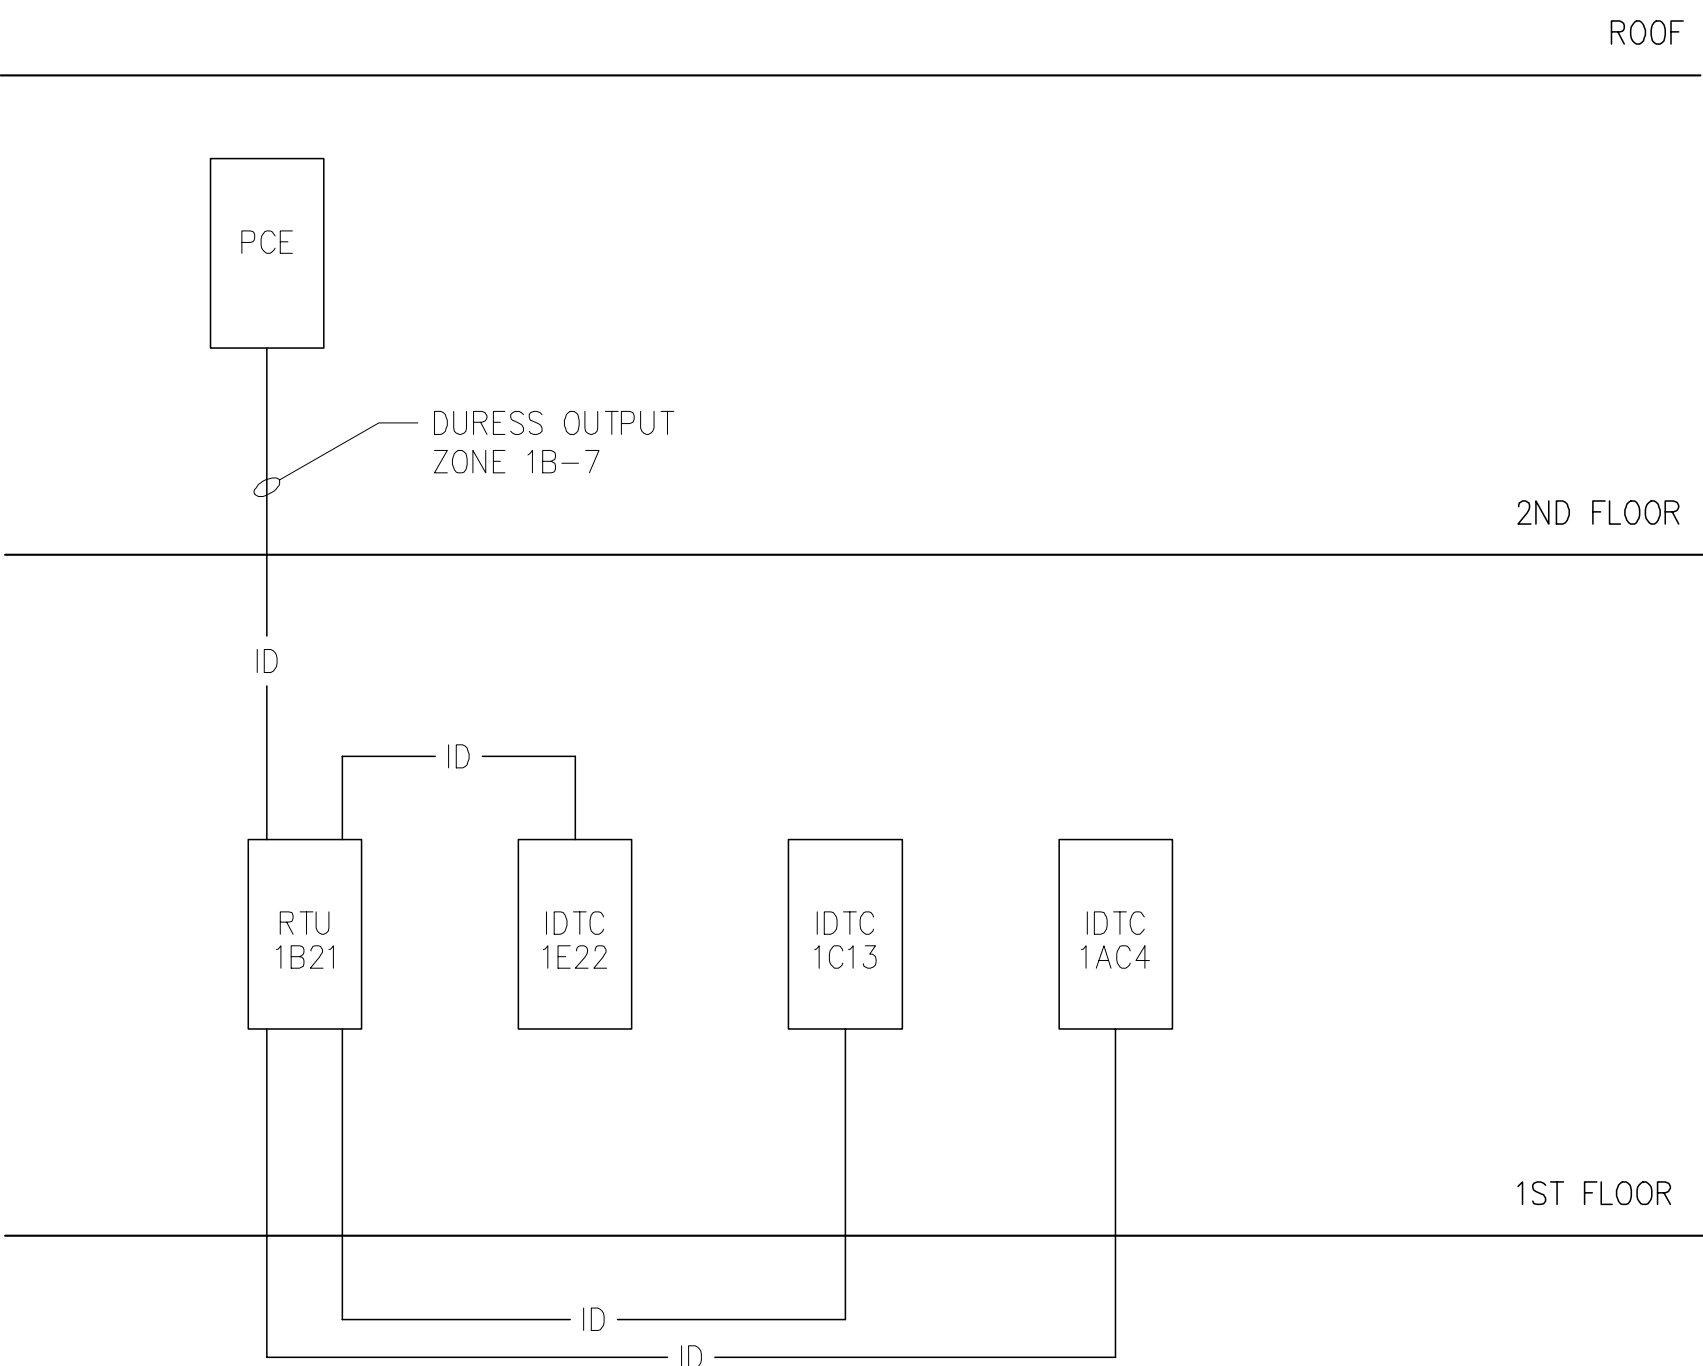

SINGLE LINE DIAGRAM
INTRUSION DETECTION SYSYTEM

NO SCALE

IF SHEET IS LESS THAN 28"x42", IT IS A REDUCED PRINT, SCALE REDUCED ACCORDINGLY.

EC10-1

MEDICAL/DENTAL CLINIC			
INTRUSION DETECTION SYSTEM – SINGLE LINE DIAGRAM			
SIZE	CODE IDENT. NO.	DRAWING NO.	
F	XXXXX	8144819	
SCALE:	AS SHOWN	SPEC.	11996048
		SHEET	314 OF 316