REVISIONS				
SYM	DESCRIPTION	PREPARED BY	DATE	APPROVED

NOTES:

1. ON THE TWO "Y2" FIXTURES CONNECT THE "e" SWITCH TO THE UNFILTERED GENERAL ILLUMINATION COMPARTMENTS AND THE "f" SWITCH TO THE FILTERED COMPARTMENTS.
2. CONNECT TO 120V RECEPTACLE CIRCUIT N22 C:20. SEE SHEET EP2-9.
3. LIGHTING CONTRACTOR MOUNTED ABOVE CEILING.

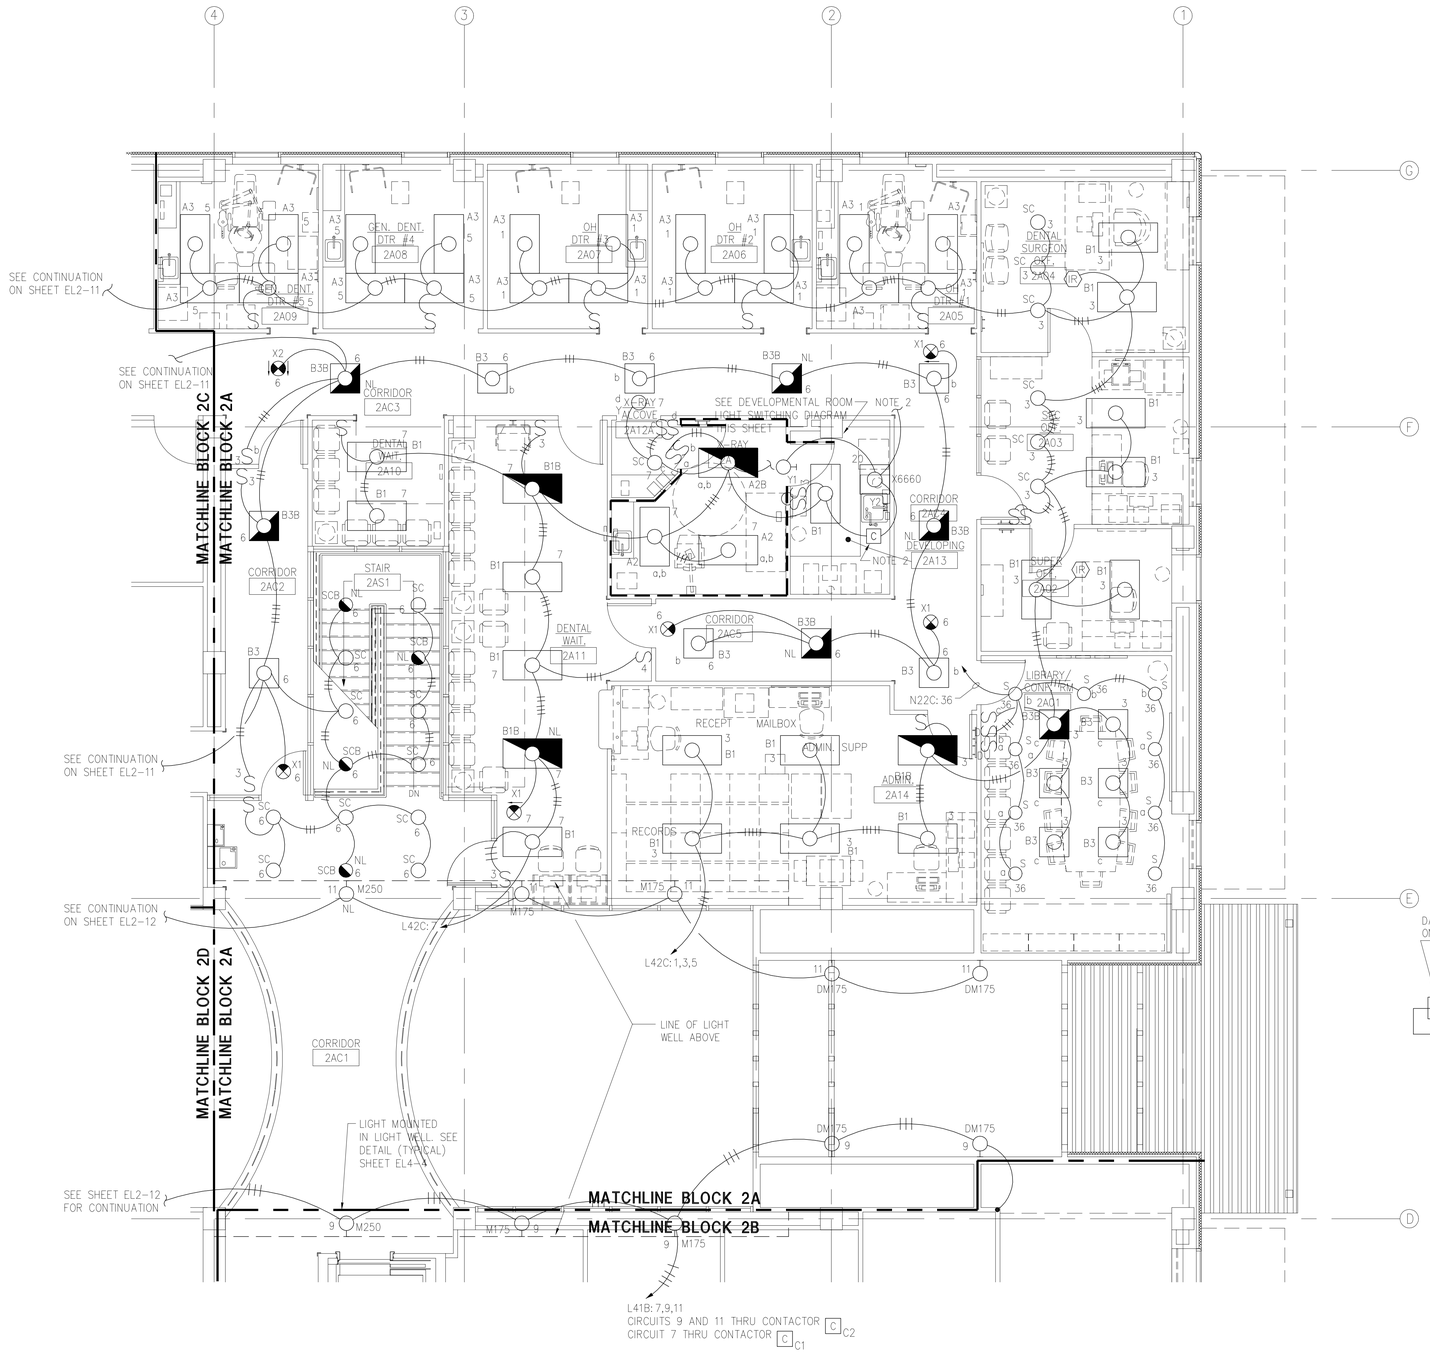

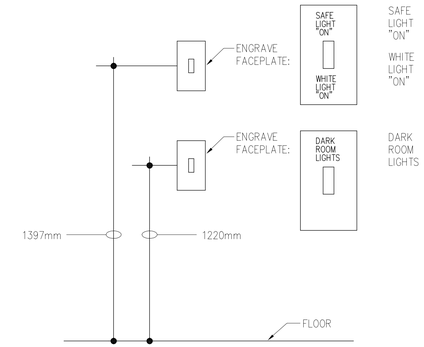

DARK ROOM SWITCH ELEVATION
MOUNTING HEIGHTS & ENGRAVINGS
FOR LIGHT SWITCHES
ROOM C2A13

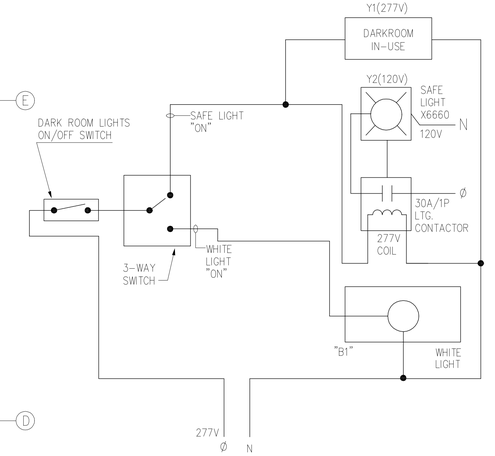

LIGHT SWITCHING DIAGRAM FOR X-RAY DEVELOPING ROOM 2A13

NOT TO SCALE



2ND FLOOR BLOCK 2A
KEY PLAN N

LIGHTING SECOND FLOOR PLAN BLOCK 2A

SCALE: 1:50

0 500 1000 2000 4000
GRAPHIC SCALE 1 : 50

IF SHEET IS LESS THAN 28"X42", IT IS A REDUCED PRINT. SCALE REDUCED ACCORDINGLY.

EL2-9

[redacted]

MEDICAL/DENTAL CLINIC [redacted]

LIGHTING – SECOND FLOOR PLAN – BLOCK 2A

SIZE	CODE IDENT. NO.	DRAWING NO.
F	XXXXX	[redacted] 8144770
		CONST. CONTR. NO. [redacted]
SCALE: AS SHOWN		SPEC. 11996048 SHEET 265 OF 316