




REVISIONS				
SYM	DESCRIPTION	PREPARED BY	DATE	APPROVED

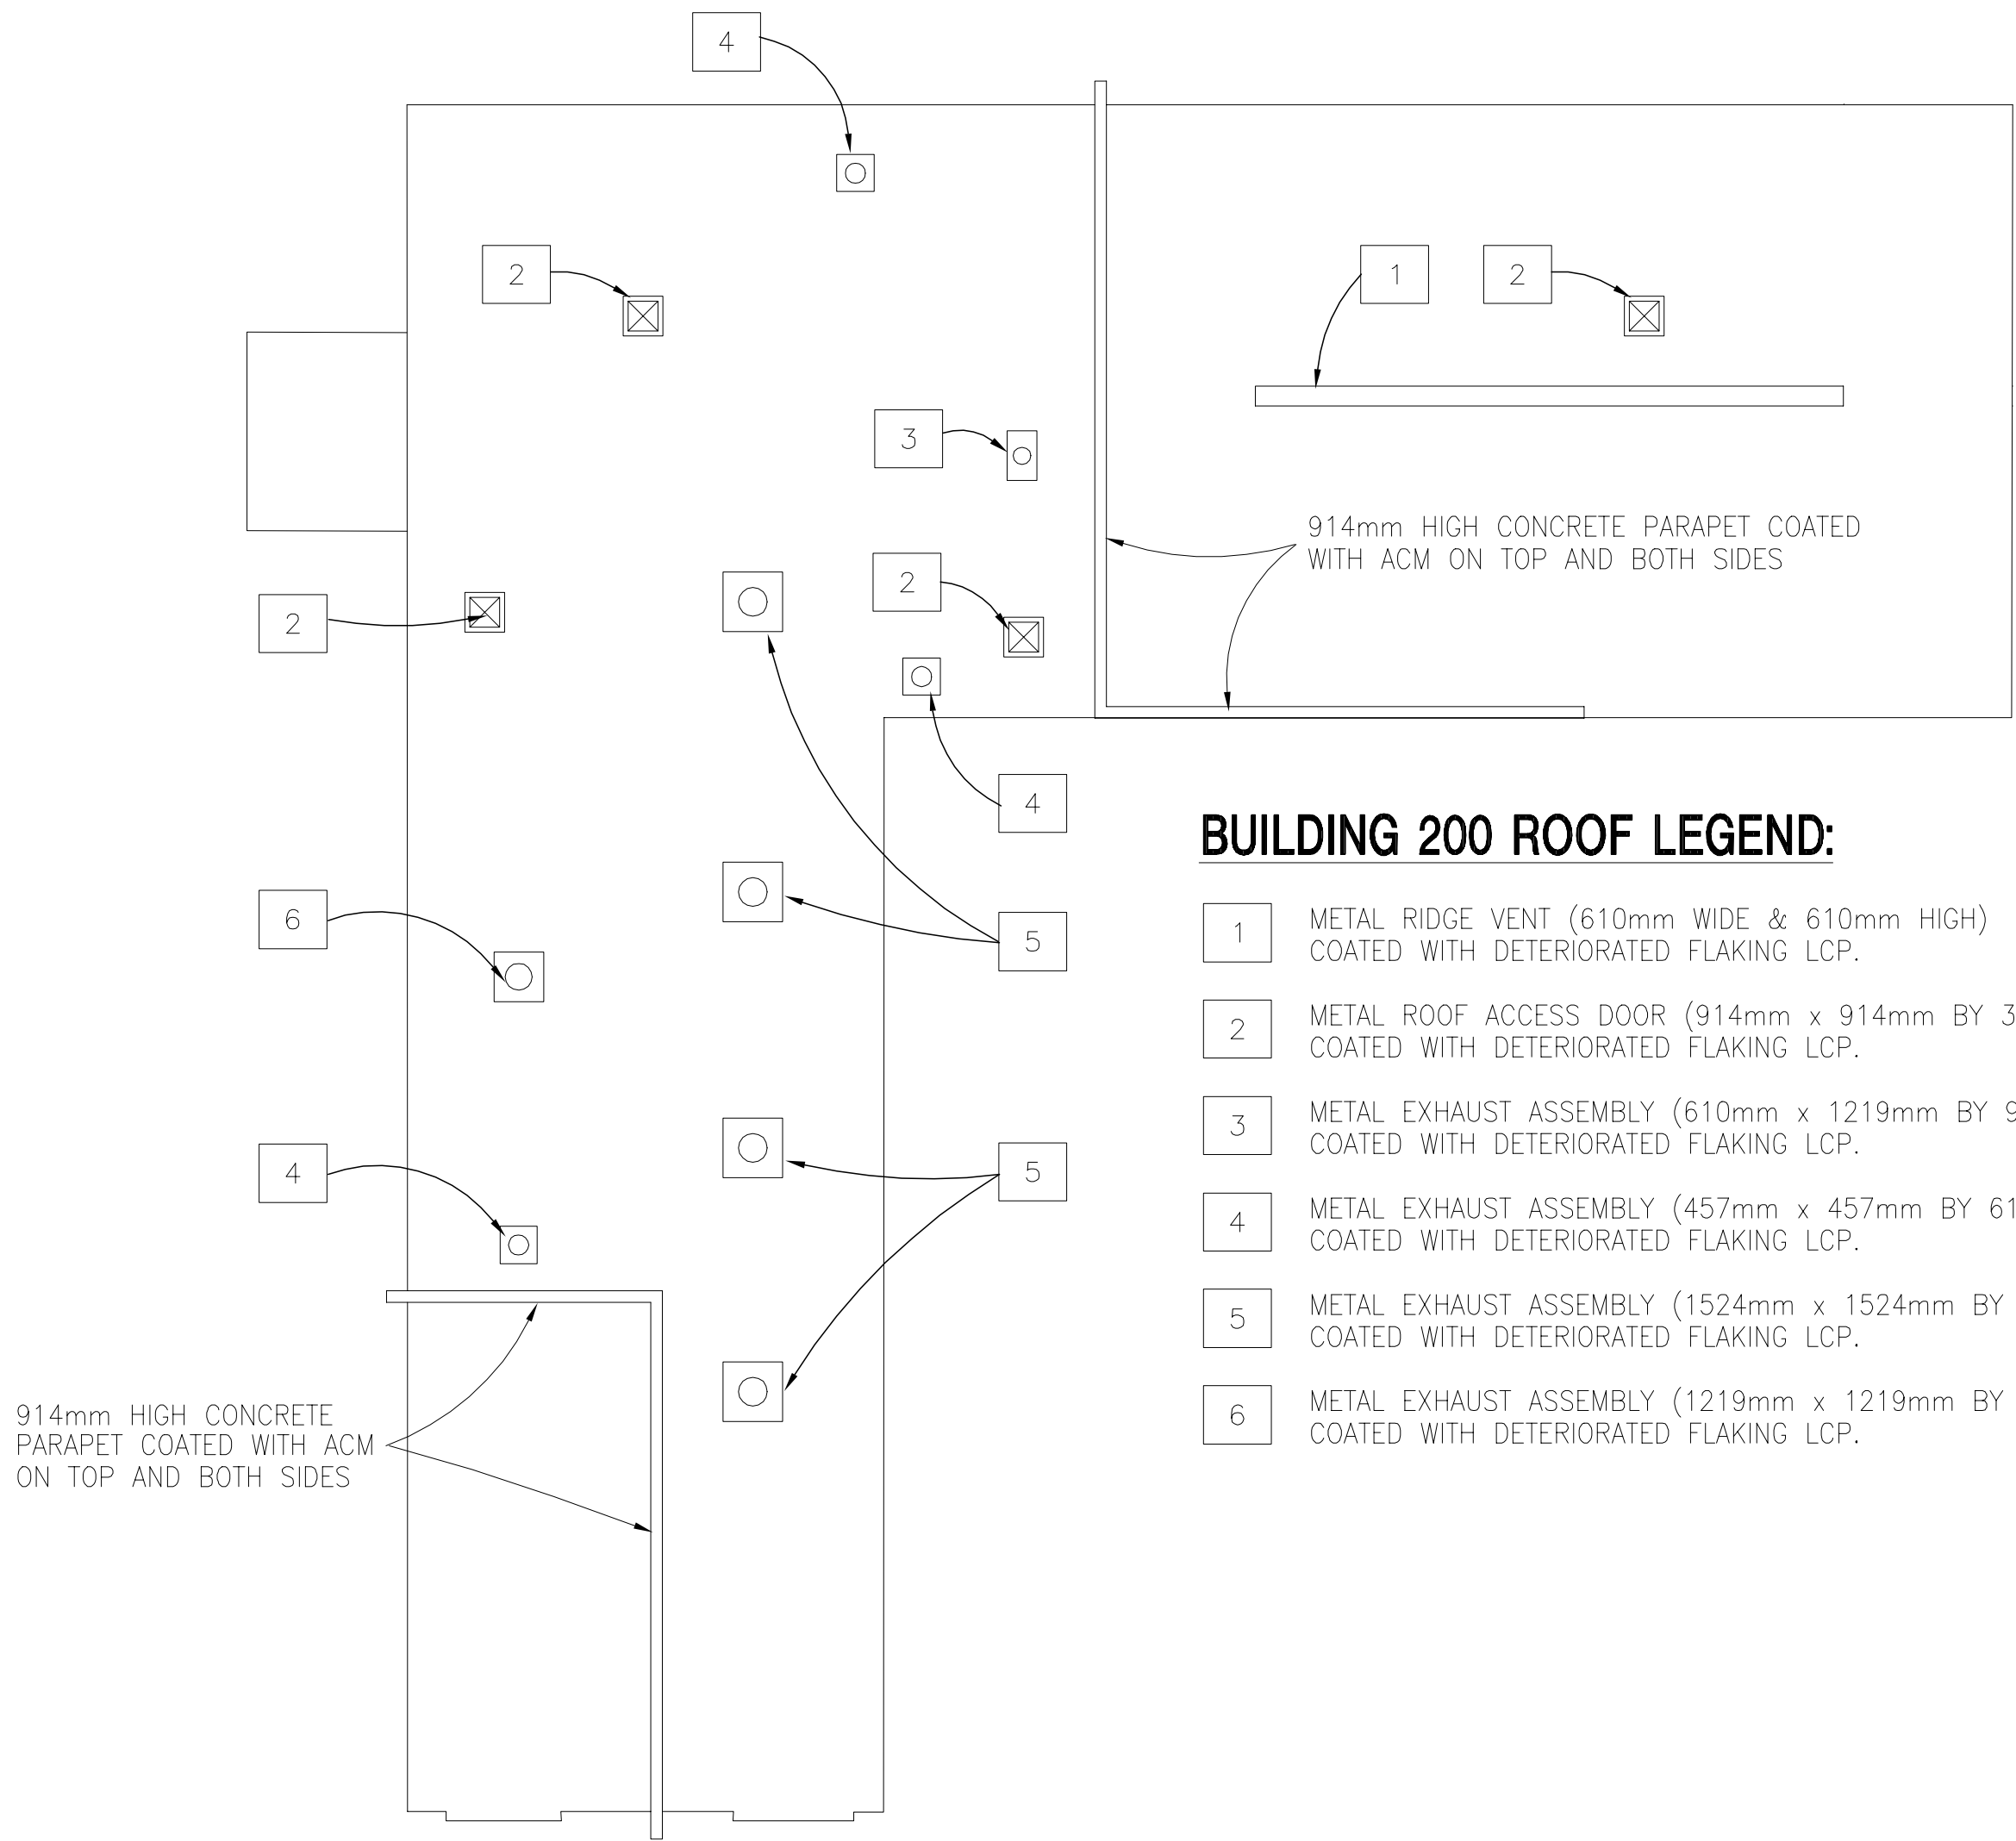

BLDG. 200 - ROOF PLAN
SCALE 1:200

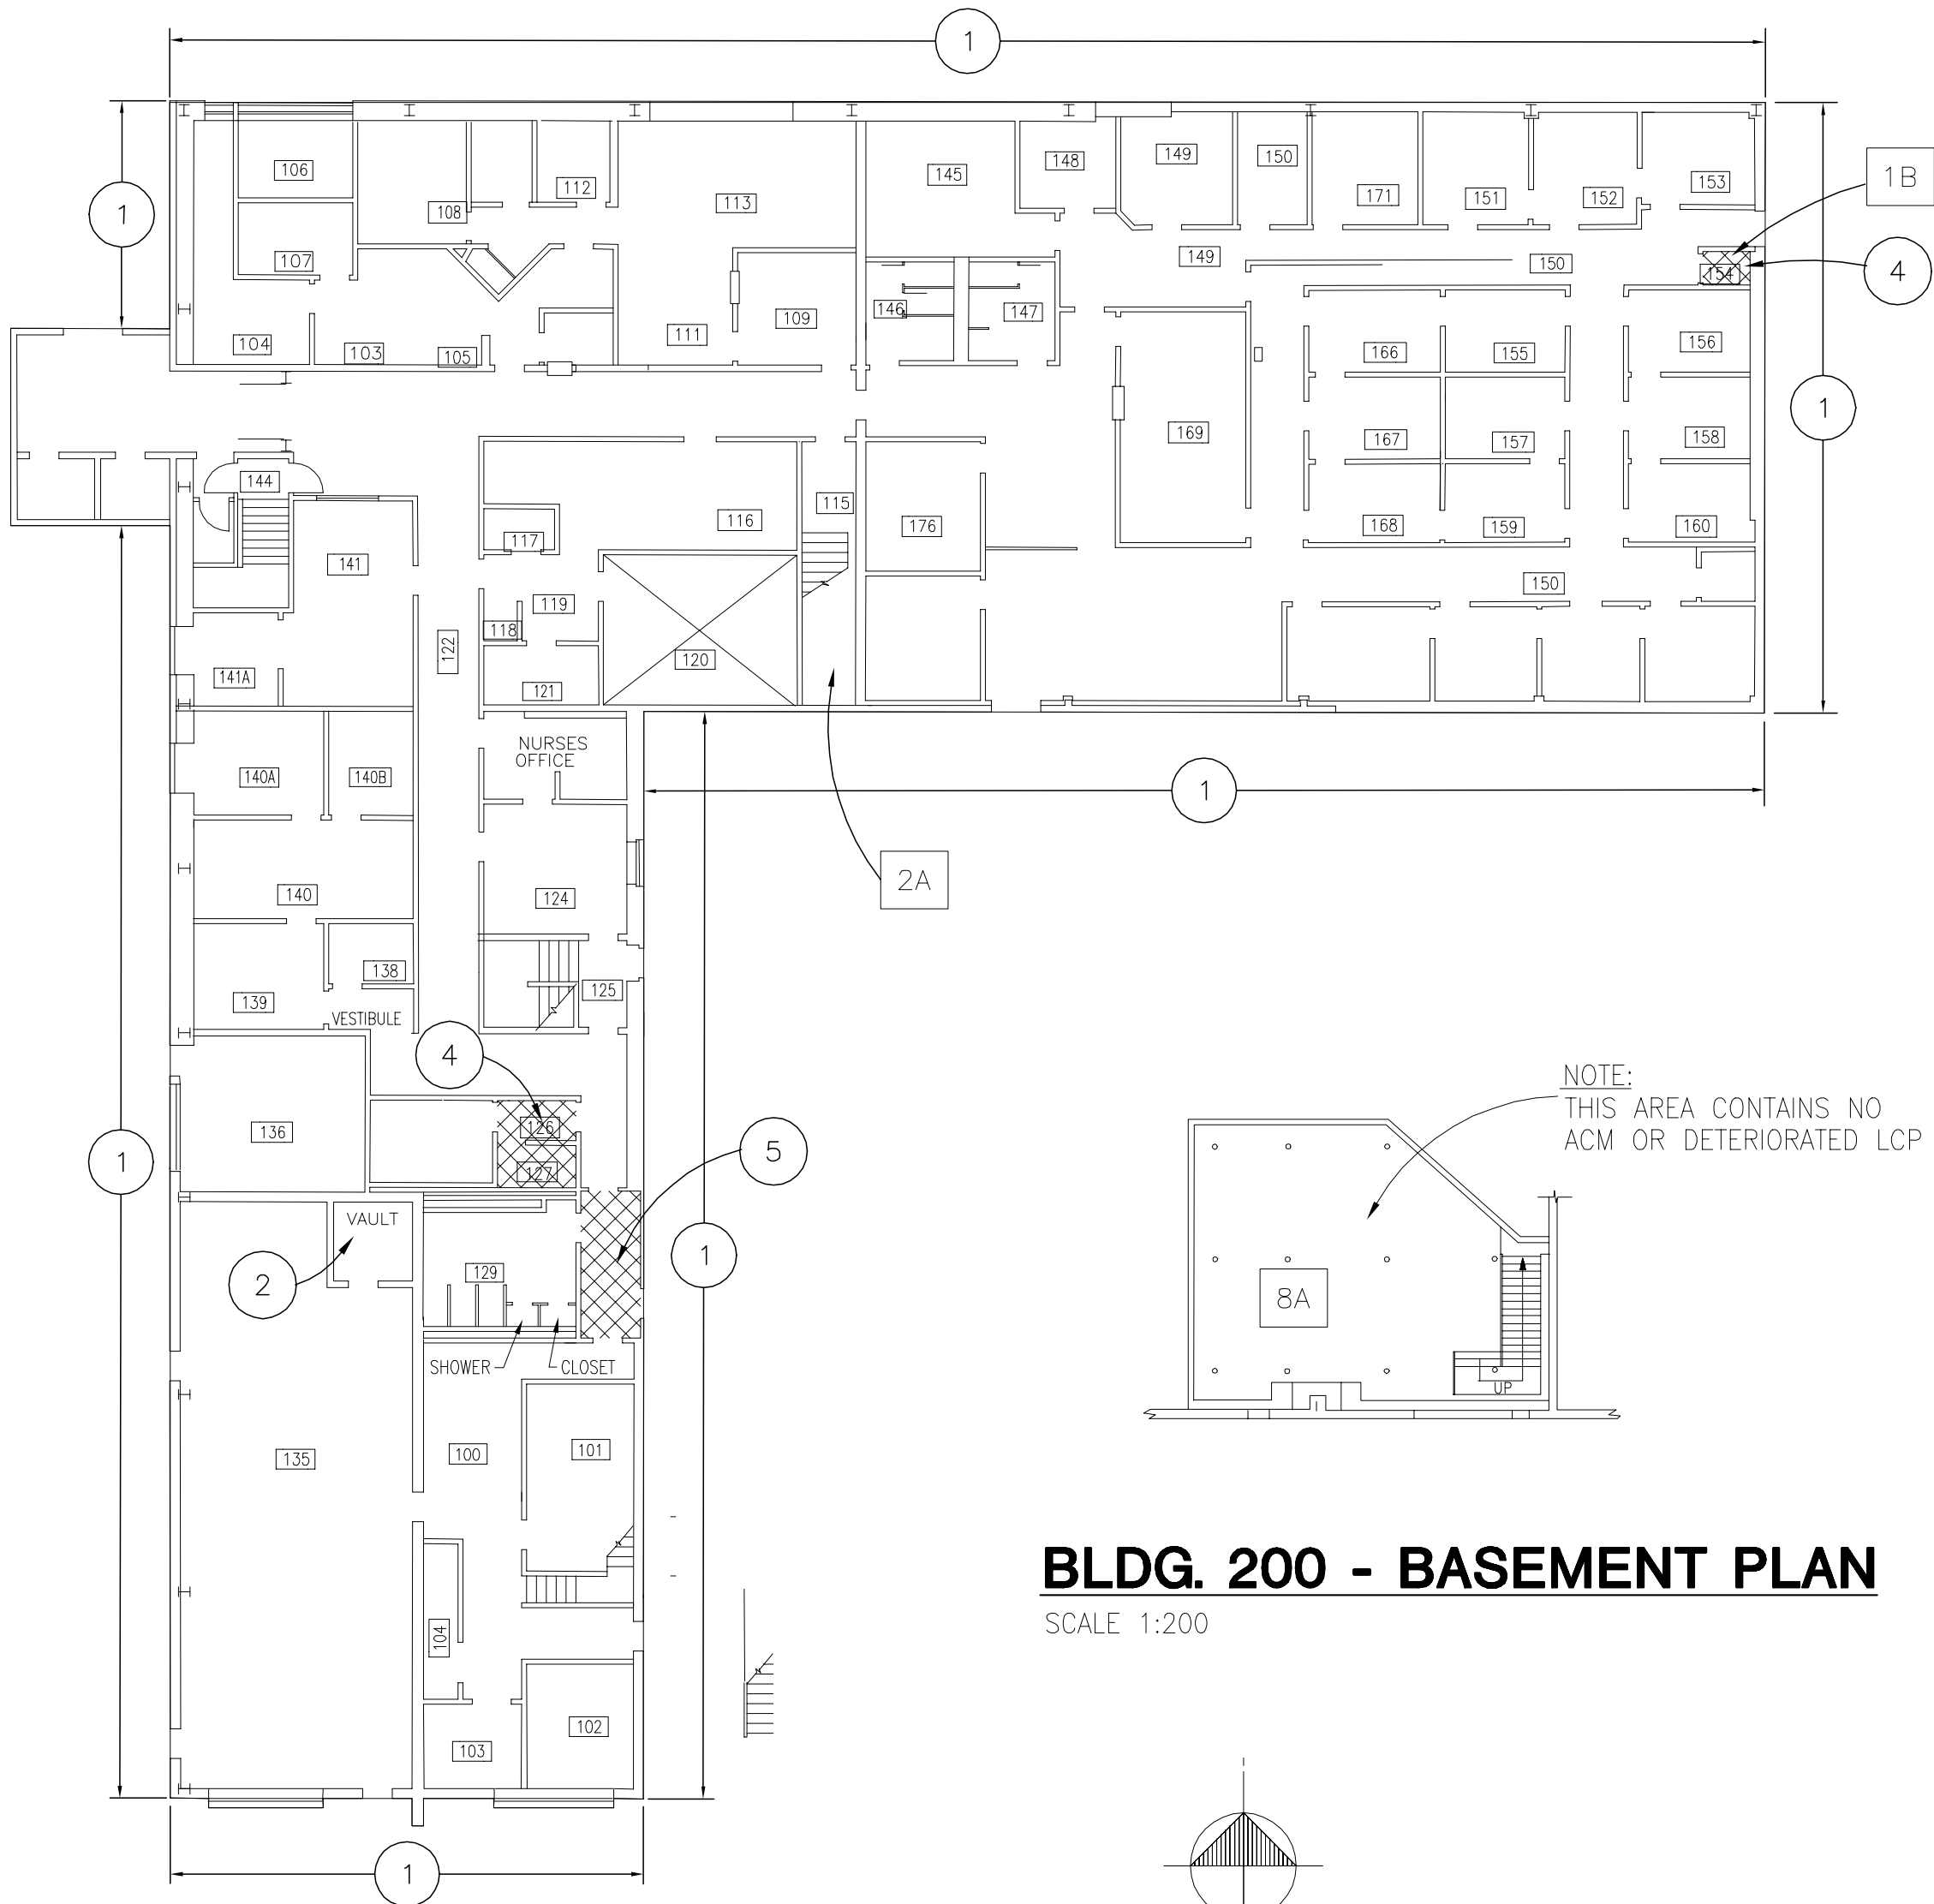

BLDG. 200 - FIRST FLOOR PLAN
SCALE 1:200

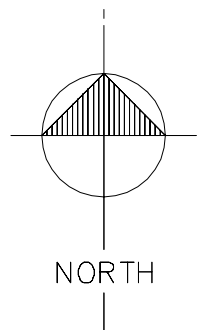


BLDG. 200 - BASEMENT PLAN
SCALE 1:200

BUILDING 200 MERCURY AND PCB REMOVAL LEGEND:

- 1B INDICATES TYPE OF LIGHT FIXTURE
DENOTES QUANTITY OF LIGHT FIXTURES
- A = 305mm x 1829mm SURFACE MOUNTED FIXTURE WITH 1 PCB BALLAST AND 2 MERCURY LAMPS
- B = 610mm x 610mm SURFACE MOUNTED FIXTURE WITH 1 PCB BALLAST AND 2 MERCURY LAMPS
- C = 305mm x 2438mm SUSPENDED ABANDONED LIGHT FIXTURE WITH 1 PCB BALLAST (NO LAMPS)

NOTE:
THESE PLANS AND THIS LEGEND INDICATE THE LOCATIONS OF LIGHT FIXTURES WHICH CONTAIN PCB BALLAST AND THE LOCATIONS OF LIGHT FIXTURES WITH MERCURY CONTAINING LAMPS IN SPACES WHERE LIGHT FIXTURES MAY NOT REASONABLY BE ANTICIPATED. THE CONTRACTOR SHALL ASSUME THAT ALL OTHER ROOMS AND FINISHED SPACES INDICED ON THE PLANS CONTAIN FLUORESCENT LIGHT FIXTURES WITH MERCURY CONTAINING LAMPS.

REFER TO SHEET HM-8 FOR NOTES APPLICABLE TO THE WORK INDICATED ON THIS SHEET.

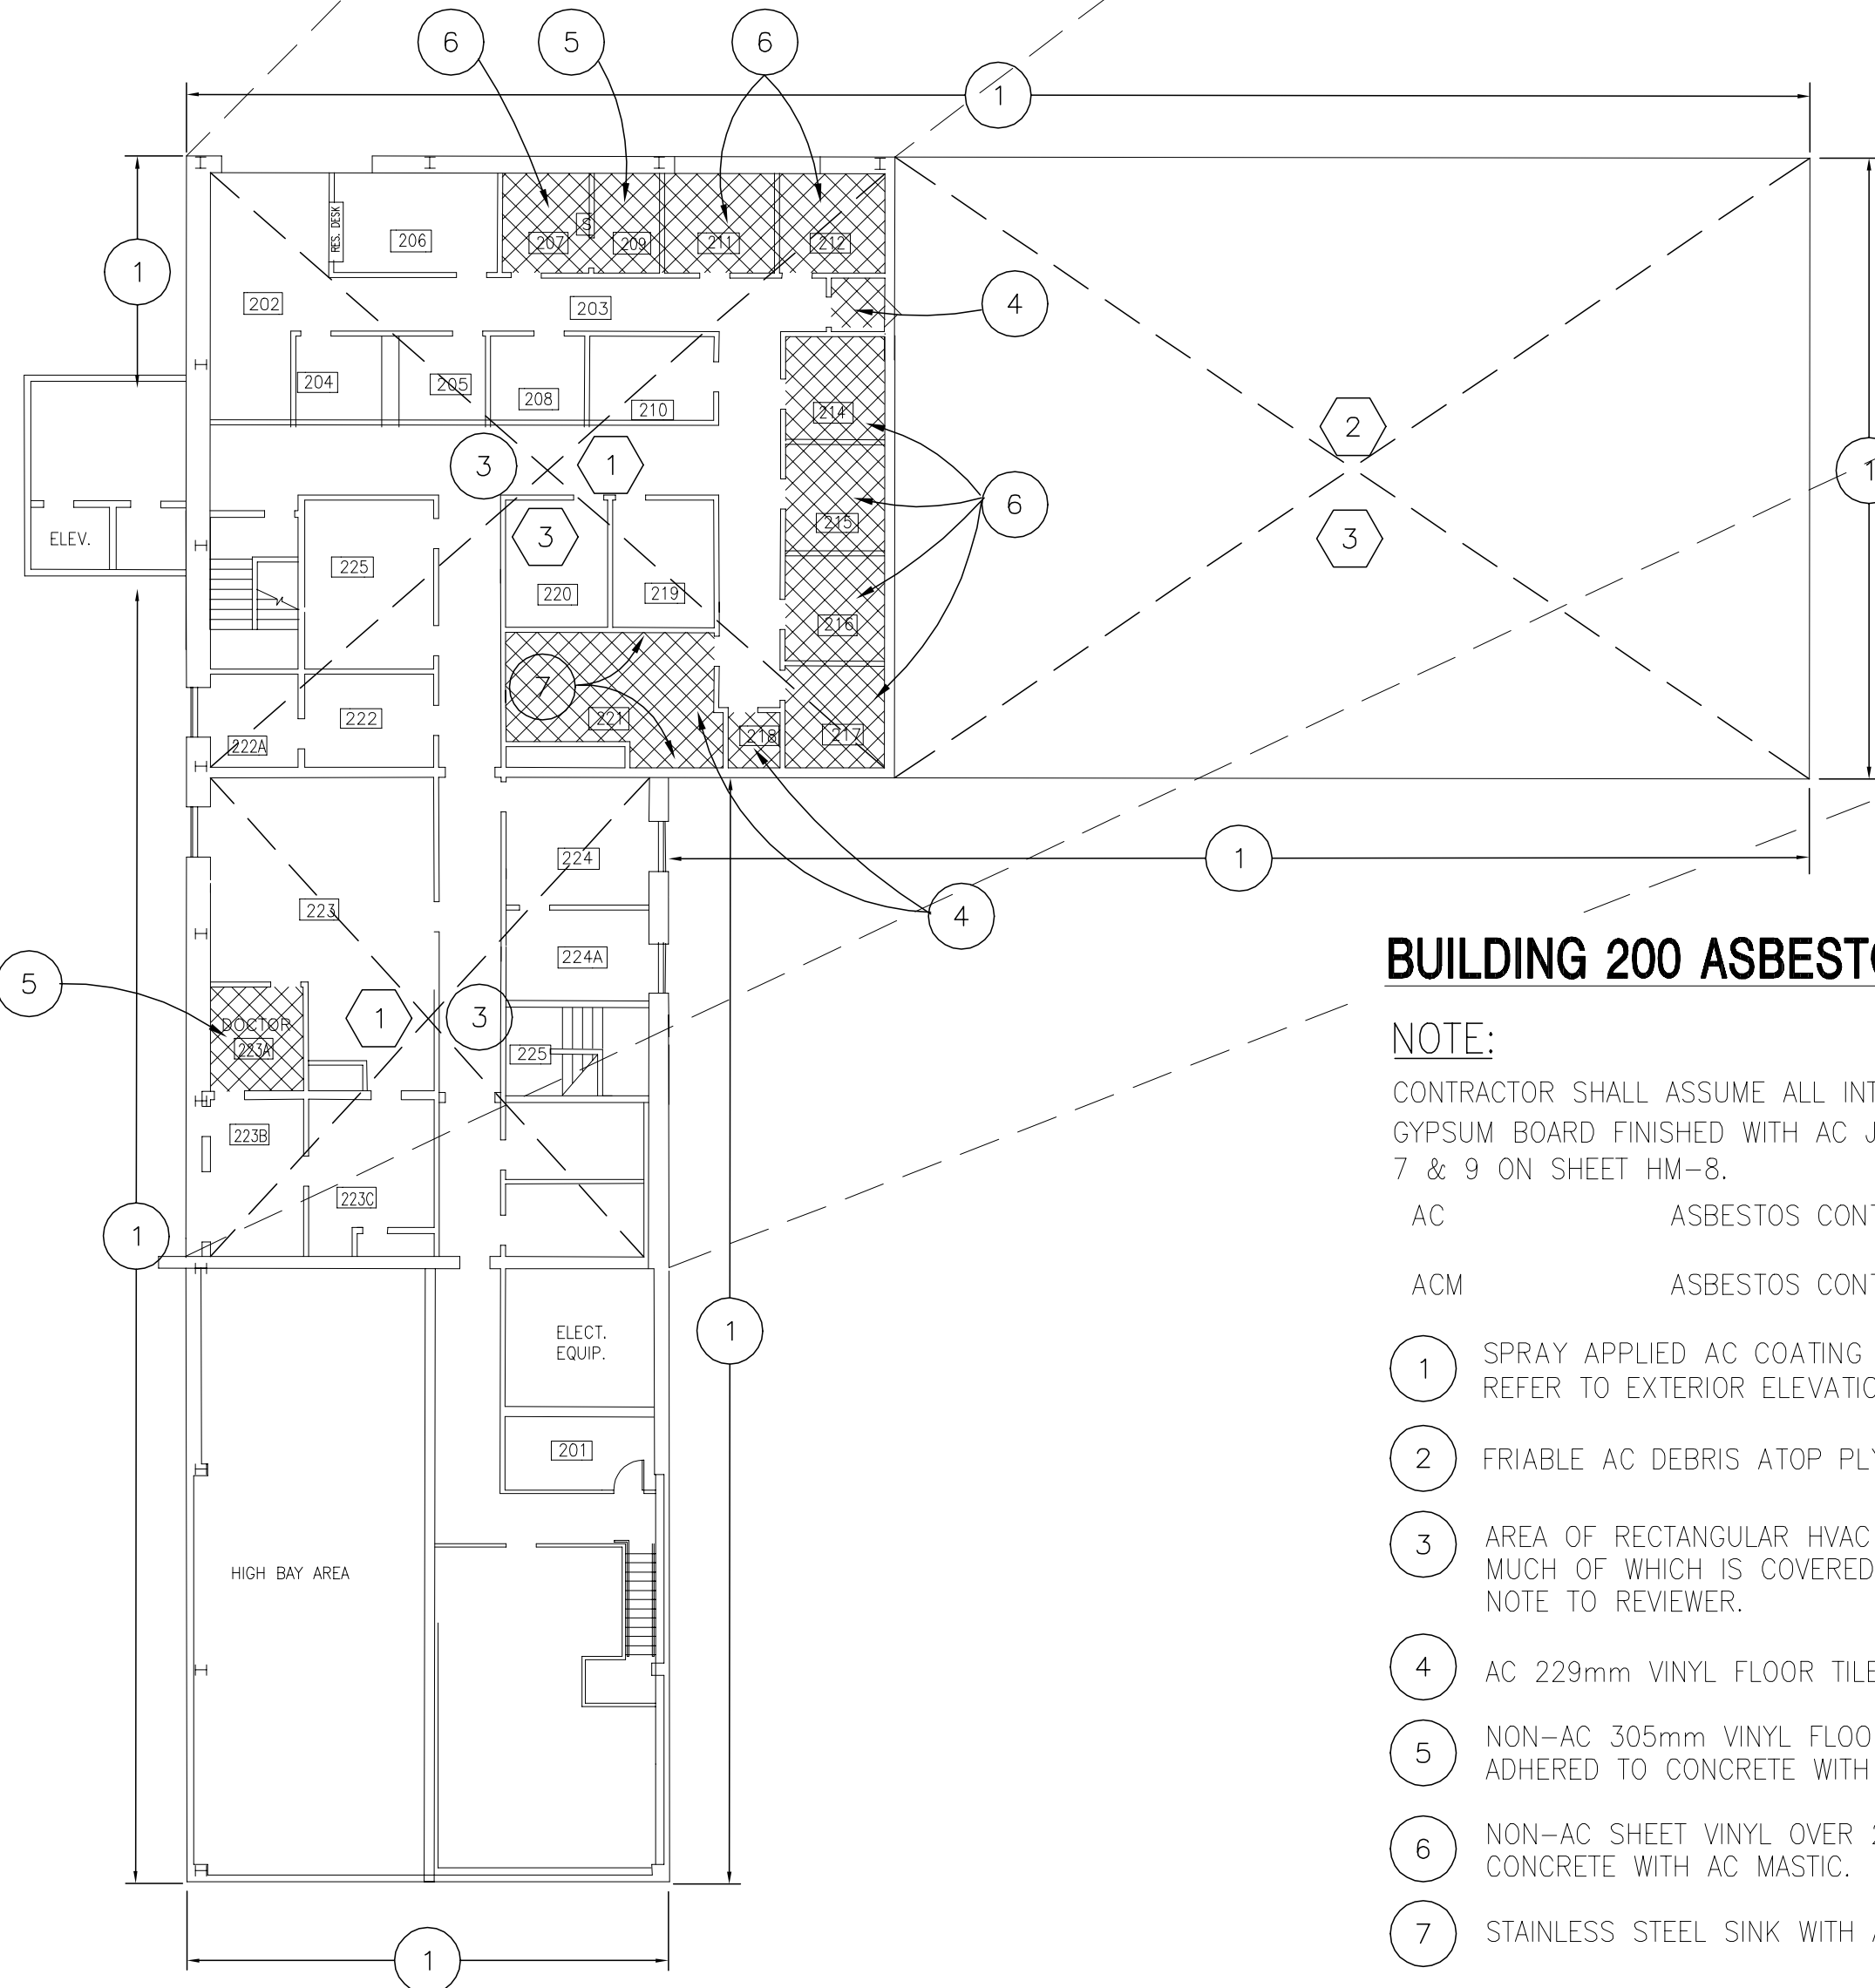


BLDG. 200 - SECOND FLOOR PLAN
SCALE 1:200

BUILDING 200 ASBESTOS REMOVAL LEGEND:

NOTE:
CONTRACTOR SHALL ASSUME ALL INTERIOR WALLS IN BUILDING 200 ARE GYPSUM BOARD FINISHED WITH AC JOINT COMPOUND. REFER TO NOTES 7 & 9 ON SHEET HM-2 AND HM-3.

- AC ASBESTOS CONTAINING
- ACM ASBESTOS CONTAINING MATERIAL
- 1 SPRAY APPLIED AC COATING ON EXTERIOR OF BUILDING. REFER TO EXTERIOR ELEVATIONS ON SHEETS HM-2 AND HM-3.
- 2 FRIABLE AC DEBRIS ATOP PLYWOOD DECK ABOVE VAULT.
- 3 AREA OF RECTANGULAR HVAC DUCTS SEALED WITH FRIABLE AC TAPE, MUCH OF WHICH IS COVERED BY NON-AC FIBERGLASS INSULATION. NOTE TO REVIEWER.
- 4 AC 229mm VINYL FLOOR TILE ADHERED BY AC MASTIC TO CONCRETE.
- 5 NON-AC 305mm VINYL FLOOR TILE OVER 229mm VINYL FLOOR TILE ADHERED TO CONCRETE WITH AC MASTIC.
- 6 NON-AC SHEET VINYL OVER 229mm VINYL FLOOR TILE ADHERED TO CONCRETE WITH AC MASTIC.
- 7 STAINLESS STEEL SINK WITH AC UNDERCOATING.


- AREA OF AC FLOORING
- HVAC DUCT WITH FRIABLE AC TAPE ON JOINTS BENEATH FIBERGLASS INSULATION

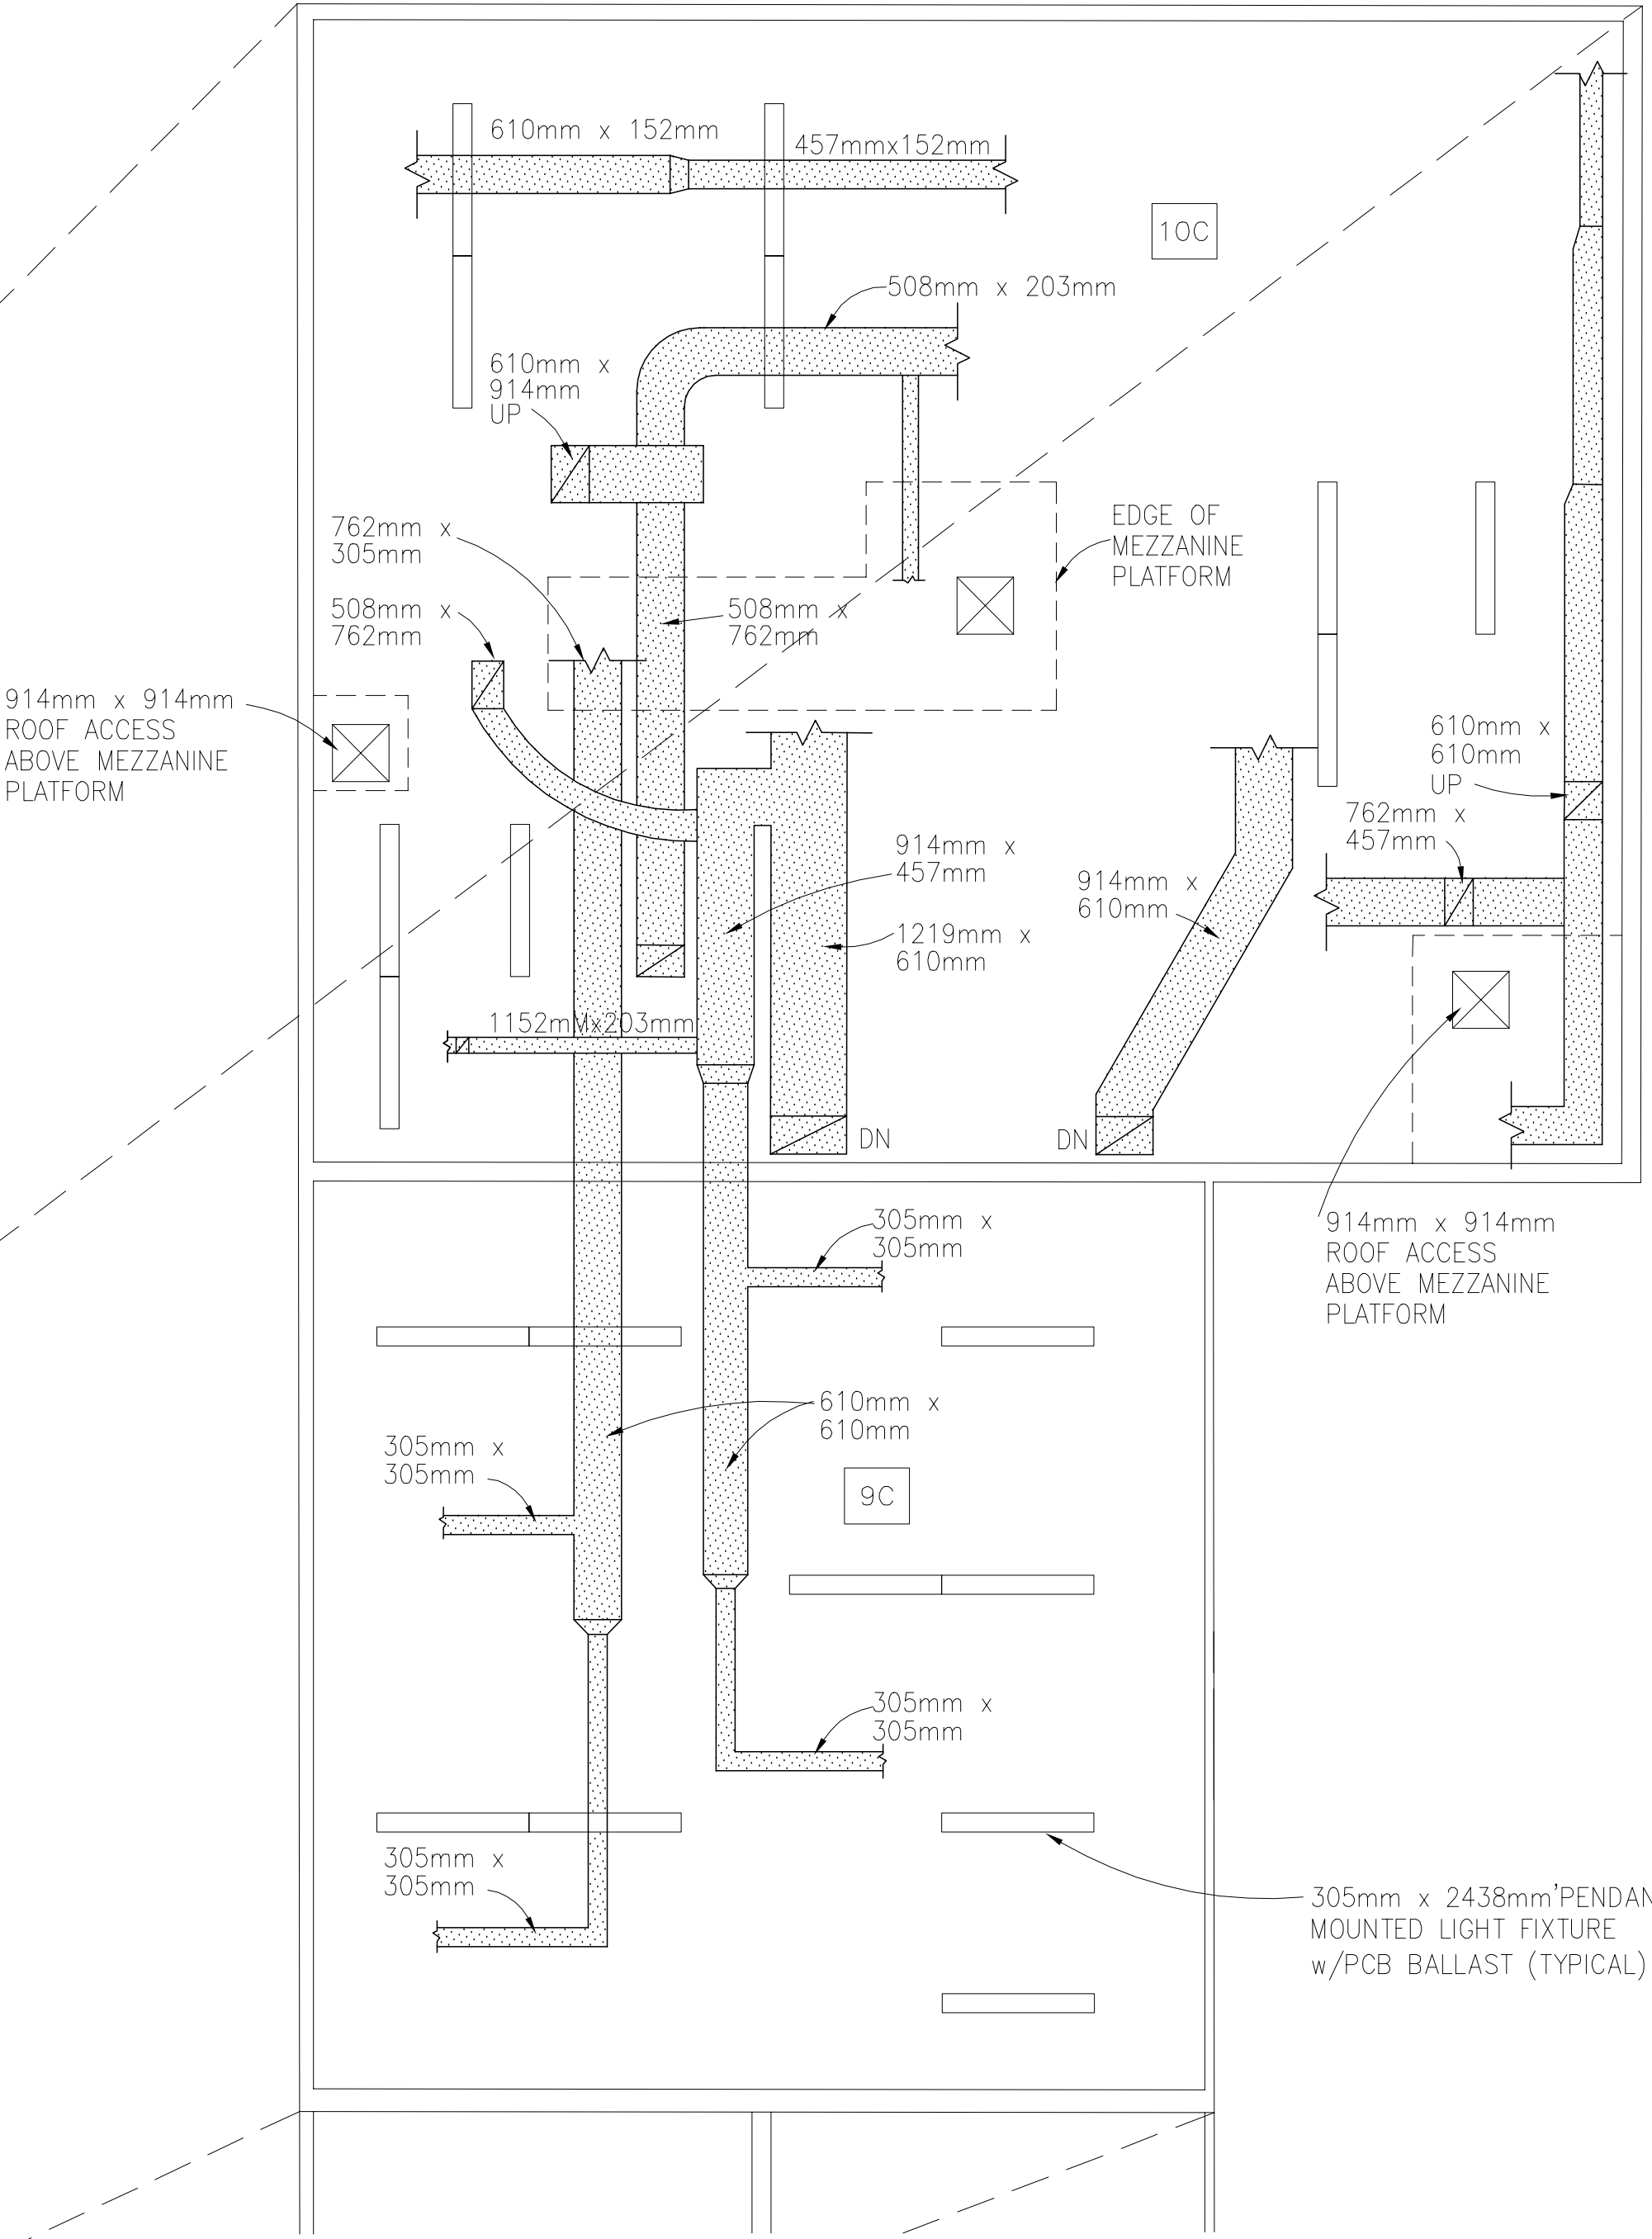

BLDG. 200 - MEZZANINE PLAN
SCALE 1:100

BUILDING 200 LEAD PAINT REMOVAL LEGEND:

- LCP = LEAD CONTAINING PAINT
- 1 AREA OF DETERIORATED PAINT CHIPS DEBRIS ATOP 2nd FLOOR CEILING TILES, FIBERGLASS INSULATION, HVAC EQUIP., HVAC DUCTS, STEEL FRAMING AND OTHER ABOVE CEILING SURFACES.
- 2 AREA OF DETERIORATED PAINT CHIPS ON SUSPENDED WALK WAYS, CABLE TRAYS, STEEL FRAMING, SPRINKLER PIPES AND OTHER ITEMS BELOW ROOF IN HIGH BAY AREA ABOVE FIRST FLOOR CEILING.
- 3 DETERIORATED PAINT ON STRUCTURAL STEEL FRAMING INSIDE FACE OF EXTERIOR PANELS, AND UNDERSIDE OF ROOF DECK.

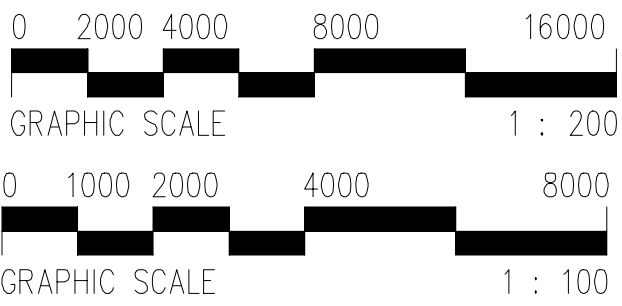

IF SHEET IS LESS THAN 28"x42", IT IS A REDUCED PRINT. SCALE REDUCED ACCORDINGLY.

HM-1

MEDICAL/DENTAL CLINIC			
HAZARDOUS MATERIAL REMOVAL BUILDING 200 PLANS			
SIZE	CODE IDENT. NO.	DRAWING NO.	8144540
F	XXXXX	CONST. CONTR. NO.	
SCALE:	AS SHOWN	SPEC.	11996048
		SHEET	36 OF 316